

# System SLIO

**IM | 06x-1xA0x | Manual**

HB300 | IM | 06x-1xA0x | en | 25-10

Interface module Line extension - IM 06x



YASKAWA Europe GmbH  
Philipp-Reis-Str. 6  
65795 Hattersheim  
Germany  
Tel.: +49 6196 569-300  
Fax: +49 6196 569-398  
Email: [info@yaskawa.eu](mailto:info@yaskawa.eu)  
Internet: [www.yaskawa.eu.com](http://www.yaskawa.eu.com)

## Table of contents

|          |   |           |
|----------|---|-----------|
| <b>1</b> | <b>General</b>                                  | <b>5</b>  |
| 1.1      | About this manual                               | 5         |
| 1.2      | Copyright © YASKAWA Europe GmbH                 | 7         |
| 1.3      | Safety instructions                             | 8         |
| <b>2</b> | <b>Basics and mounting</b>                      | <b>11</b> |
| 2.1      | Safety notes for the user                       | 11        |
| 2.2      | System conception                               | 12        |
| 2.2.1    | Overview  | 12        |
| 2.2.2    | Components                                      | 13        |
| 2.2.3    | Accessories                                     | 16        |
| 2.2.4    | Hardware revision                               | 18        |
| 2.3      | Dimensions                                      | 18        |
| 2.4      | Grounding concept                               | 21        |
| 2.4.1    | Shielding                                       | 21        |
| 2.5      | Mounting line extension                         | 22        |
| 2.5.1    | Mounting line extension MainDevice              | 23        |
| 2.5.2    | Mounting line extension SubDevice               | 24        |
| 2.6      | Wiring line extension                           | 26        |
| 2.6.1    | Wiring line extension MainDevice                | 26        |
| 2.6.2    | Wiring line extension SubDevice                 | 26        |
| 2.6.3    | Line extension - connection cable               | 29        |
| 2.7      | Demounting line extension                       | 30        |
| 2.7.1    | Demounting line extension MainDevice            | 30        |
| 2.7.2    | Demounting line extension SubDevice             | 31        |
| 2.8      | Trouble shooting - LEDs                         | 32        |
| 2.9      | Industrial security and installation guidelines | 33        |
| 2.9.1    | Industrial security in information technology   | 33        |
| 2.9.2    | Installation guidelines                         | 35        |
| 2.10     | General data for the System SLIO                | 37        |
| 2.10.1   | Use in difficult operating conditions           | 39        |
| <b>3</b> | <b>Deployment</b>                               | <b>40</b> |
| 3.1      | Properties                                      | 40        |
| 3.2      | Structure                                       | 41        |
| 3.2.1    | Line extension MainDevice                       | 41        |
| 3.2.2    | Line extension SubDevice                        | 42        |
| 3.3      | Mounting and wiring                             | 45        |
| 3.4      | Deployment 06x-1xA00 - version 1                | 46        |
| 3.5      | Deployment 06x-1xA01 - version 2                | 48        |

|       |  |    |
|-------|--|----|
| 3.6   | Technical data. . . . .                                  | 50 |
| 3.6.1 | 060-1AA00 Line extension MainDevice - version 1. . . . . | 50 |
| 3.6.2 | 060-1AA01 Line extension MainDevice - version 2. . . . . | 52 |
| 3.6.3 | 061-1BA00 Line extension SubDevice - version 1. . . . .  | 54 |
| 3.6.4 | 061-1BA01 Line extension SubDevice - version 2. . . . .  | 56 |

# 1 General

## 1.1 About this manual

### Objective and contents

This manual describes the line extensions IM 060 and IM 061 of the System SLIO.

- It describes the structure, configuration and application.
- The manual is targeted at users with good basic knowledge in automation technology.
- The manual does not replace sufficient basic knowledge of automation technology or sufficient familiarity with the specific product.
- The manual consists of chapters. Each chapter describes a completed topic.
- For guidance, the manual provides:
  - An overall table of contents at the beginning of the manual
  - References with pages numbers

### Validity of the documentation

| Product | Description                           | Order no. | as of version: |
|---------|---------------------------------------|-----------|----------------|
| IM 060  | Line extension MainDevice - version 1 | 060-1AA00 | HW: 01         |
| IM 060  | Line extension MainDevice - version 2 | 060-1AA01 | HW: 01         |
| IM 061  | Line extension SubDevice - version 1  | 061-1BA00 | HW: 01         |
| IM 061  | Line extension SubDevice - version 2  | 061-1BA01 | HW: 01         |

The following designations are used in the manual:

- Line extension 06x-1xA00 is designated as '*version 1*'.
- Line extension 06x-1xA01 is designated as '*version 2*'.

### Documentation

In the context of the use of the pertinent Yaskawa product, the manual is to be made accessible to the pertinent qualified personnel in:

- Project engineering
- Installation department
- Commissioning
- Operation

**Icons and headings**

Important passages in the text are highlighted by following icons and headings:

**DANGER**

- Immediate danger to life and limb of personnel and others.
- Non-compliance will cause death or serious injury.

**CAUTION**

- Hazardous situation to life and limb of personnel and others. Non-compliance may cause slight injuries.
- This symbol is also used as warning of damages to property.

**NOTICE**

- Designates a possibly harmful situation.
- Non-compliance can damage the product or something in its environment.



*Supplementary information and useful tips.*

## 1.2 Copyright © YASKAWA Europe GmbH

### All rights reserved

This document contains protected information of Yaskawa and may not be disclosed or used outside of an agreement made in advance with Yaskawa and only in accordance with that agreement.

This document is protected by copyright laws. Reproduction, distribution, or modification of this document or excerpts thereof is not permitted without the written consent of Yaskawa and the owner of this document, except in accordance with applicable agreements, contracts or licenses.

For permission to reproduce or distribute, please contact: YASKAWA Europe GmbH, European Headquarters, Philipp-Reis-Str. 6, 65795 Hattersheim, Germany

Tel.: +49 6196 569 300

Fax.: +49 6196 569 398

E-mail: [info@yaskawa.eu](mailto:info@yaskawa.eu)

Internet: [www.yaskawa.eu.com](http://www.yaskawa.eu.com)

### Download Center

By entering the product order number in the '*Download Center*' at [www.yaskawa.eu.com](http://www.yaskawa.eu.com), the pertinent manuals, data sheets, declarations of conformity, certificates and other helpful information for your product can be found.

### Trademarks

SLIO is a registered trademark of YASKAWA Europe GmbH.

EtherCAT® is a registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany.

EtherNet/IP is a registered trademark of Open DeviceNet Vendor Association, Inc (ODVA).

Modbus is a registered trademark of Schneider Electric.

PROFINET and PROFIBUS are registered trademarks of PROFIBUS and PROFINET International (PI).

All other trademarks, logos and service or product marks specified herein are owned by their respective companies.

### General terms of use

Every effort was made by Yaskawa to ensure that the information contained in this document was complete and correct at the time of publication. Nevertheless, the information contained therein is only owed by Yaskawa as it is available at Yaskawa. Correctness is not assured by Yaskawa, the right to change the information contained herein is always reserved by Yaskawa. There is no obligation to inform the customer of any changes. The customer is requested to actively keep this documentation up to date. The use of the products covered by these instructions, together with the associated documentation, is always at the customer's own risk, in accordance with the applicable guidelines and standards. This documentation describes the hardware and software components and functions of the product. It is possible that units are described which the customer does not have. The exact scope of delivery is described in the respective purchase contract.

### Document support

Contact your local representative of YASKAWA Europe GmbH if you have errors or questions regarding the content of this document. You can reach YASKAWA Europe GmbH via the following contact:

Email: [Documentation.HER@yaskawa.eu](mailto:Documentation.HER@yaskawa.eu)

**Technical support**

Contact your local representative of YASKAWA Europe GmbH if you encounter problems or have questions regarding the product. If such a location is not available, you can reach the Yaskawa customer service via the following contact:

YASKAWA Europe GmbH,  
European Headquarters, Philipp-Reis-Str. 6, 65795 Hattersheim, Germany  
Tel.: +49 6196 569 500 (hotline)  
Email: support@yaskawa.eu

## 1.3 Safety instructions

**General safety instructions****DANGER****Danger to life due to non-compliance with safety instructions**

Non-compliance with the safety instructions in the manual can result in serious injury or death. The manufacturer is not responsible for any injuries or damage to the equipment.

**CAUTION****Before commissioning and operating the components described in this manual, it is essential to note the following:**

- Modifications to the automation system must only be done in a voltage-free state!
- Connection and modification only by trained electricians
- National regulations and guidelines in the respective country of use must be observed and complied with (installation, protective measures, EMC, etc.)



**Intended use**

- It is the customer's responsibility to comply with all pertinent standards, codes, or regulations applicable to the use of the product, including those that apply when the Yaskawa product is used in combination with other products.
- The customer must confirm that the Yaskawa product is suitable for the customer's plant, machinery and equipment.
- If the Yaskawa product is used in a manner not specified by this manual, the protection provided by the Yaskawa product may be impaired and the use may result in material or immaterial damage.
- Contact Yaskawa to determine whether use is permitted in the following applications. If the use in the respective application is permissible, the Yaskawa product is to be used by considering additional risk assessments and specifications, and safety measures are to be provided to minimise the dangers in the event of a fault. Special caution is required and protective measures must be taken in the case of:
  - Outdoor use, use with possible chemical contamination or electrical interference, or use under conditions or in environments which are not described in product catalogs or manuals
  - Nuclear control systems, combustion systems, railway systems, aviation systems, automotive systems, medical devices, amusement machines and equipment that is specifically regulated by industry or government
  - Systems, machines and devices that can pose a risk to life or property
  - Systems that require a high degree of reliability, such as gas, water or electricity supply systems or systems that operate 24 hours a day
  - Other systems that require a similarly high level of security
- Never use the Yaskawa product in an application where failure of the product could cause serious danger to life, limb, health or property without first ensuring that the system is designed to provide the required level of safety with risk warnings and redundancy to avoid the realisation of such dangers and that the Yaskawa product is properly designed and installed.
- The connection examples and other application examples described in the product catalogs and manuals of Yaskawa are for reference purposes. Check the functionality and safety of the devices and systems actually to be used before using the Yaskawa product.
- To avoid accidental harm to third parties, read and understand all prohibitions on use and precautions, and operate the Yaskawa product correctly.

**Field of application**

- The Yaskawa product is not suited for use in life-support machines or systems.
- Please contact your Yaskawa representative or Yaskawa distributor if considering the use of the Yaskawa product for special purposes, such as machines or systems used in passenger cars, in medical, aircraft and aerospace applications, for power supply of networks, for electrical power distribution or for underwater applications.

**DANGER**

The device is not permitted for use

- in explosive environments (EX zone)

The system is designed and manufactured for proper use and use in accordance with the user manual and is designed for:

- Communication and process control
- general control and automation tasks
- for industrial use
- operation within the environmental conditions specified in the technical data
- installation in a cabinet

**DANGER**

If this Yaskawa product is used in applications where failure of the device can result in the loss of human life, a serious accident or physical injury, you must install appropriate safety devices.

- Death or serious injury can result if you do not install the safety devices properly.

**Disclaimer**

(1) The contractual and legal liability of Yaskawa and the legal representatives and vicarious agents of Yaskawa for compensation and reimbursement of expenses in relation to the content of this documentation is excluded or limited as follows:

a) For slightly negligent breaches of *Essential Contractual Duties* arising from the contractual obligation, for Yaskawa the amount of liability is limited to the foreseeable damage typical for the contract. '*Essential Contractual Duties*' are those duties that characterise the performance of the contract and on which the Yaskawa customer may reasonably rely.

(b) In each case, Yaskawa is not liable for (i) the slightly negligent breach of duties arising from the duties that are not *Essential Contractual Duties*, as well as (ii) force majeure, i.e. external events that have no operational connection and cannot be averted even by exercising the utmost care that can reasonably be expected.

(2) The aforementioned limitation of liability does not apply (i) in cases of mandatory statutory liability (in particular under the product liability law), (ii) if and to the extent that Yaskawa has assumed a guarantee or same as guaranteed procurement risk according to § 276 BGB, (iii) for culpably caused injuries to life, limb and/or health, also by representatives or vicarious agents, as well as (iv) in case of delay in the event of a fixed completion date.

(3) A reversal of the burden of proof is not associated with the provisions above.

**Disposal**

**National rules and regulations apply to the disposal of the unit!**

## 2 Basics and mounting

### 2.1 Safety notes for the user



#### **DANGER**

##### **Protection against dangerous voltages**

- When using System SLIO modules, the user must be protected from touching hazardous voltage.
- You must therefore create an insulation concept for your system that includes safe separation of the potential areas of extra-low voltage (ELV) and hazardous voltage.
- Here, observe the insulation voltages between the potential areas specified for the System SLIO modules and take suitable measures, such as using PELV/SELV power supplies for System SLIO modules.

#### **Handling of electrostatic sensitive modules**

The modules are equipped with highly integrated components in MOS technology. These components are highly sensitive to over-voltages that occur, e.g. with electrostatic discharge. The following symbol is used to identify these hazardous modules:



The symbol is located on modules, module racks or on packaging and thus indicates electrostatic sensitive modules. Electrostatic sensitive modules can be destroyed by energies and voltages that are far below the limits of human perception. If a person who is not electrically discharged handles electrostatic sensitive modules, voltages can occur and damage components and thus impair the functionality of the modules or render the modules unusable. Modules damaged in this way are in most cases not immediately recognized as faulty. The error can only appear after a long period of operation. Components damaged by static discharge can show temporary faults when exposed to temperature changes, vibrations or load changes. Only the consistent use of protective devices and responsible observance of the handling rules can effectively prevent malfunctions and failures on electrostatic sensitive modules.

#### **Shipping of modules**

Please always use the original packaging for shipping.

#### **Measurement and modification of electrostatic sensitive modules**

For measurements on electrostatic sensitive modules the following must be observed:

- Floating measuring instruments must be discharged before use.
- Measuring instruments used must be grounded.

When modifying electrostatic sensitive modules, ensure that a grounded soldering iron is used.




#### **CAUTION**

When working with and on electrostatic sensitive modules, make sure that personnel and equipment are adequately grounded.

## 2.2 System conception

### 2.2.1 Overview

The System SLIO is a modular automation system for assembly on a 35mm profile rail. By means of the periphery modules with 2, 4, 8 and 16 channels this system may properly be adapted matching to your automation tasks. The wiring complexity is low, because the supply of the DC 24V power section supply is integrated to the backplane bus and defective modules may be replaced with standing wiring. By deployment of the power modules in contrasting colors within the system, further isolated areas may be defined for the DC 24V power section supply, respectively the electronic power supply may be extended with 2A.

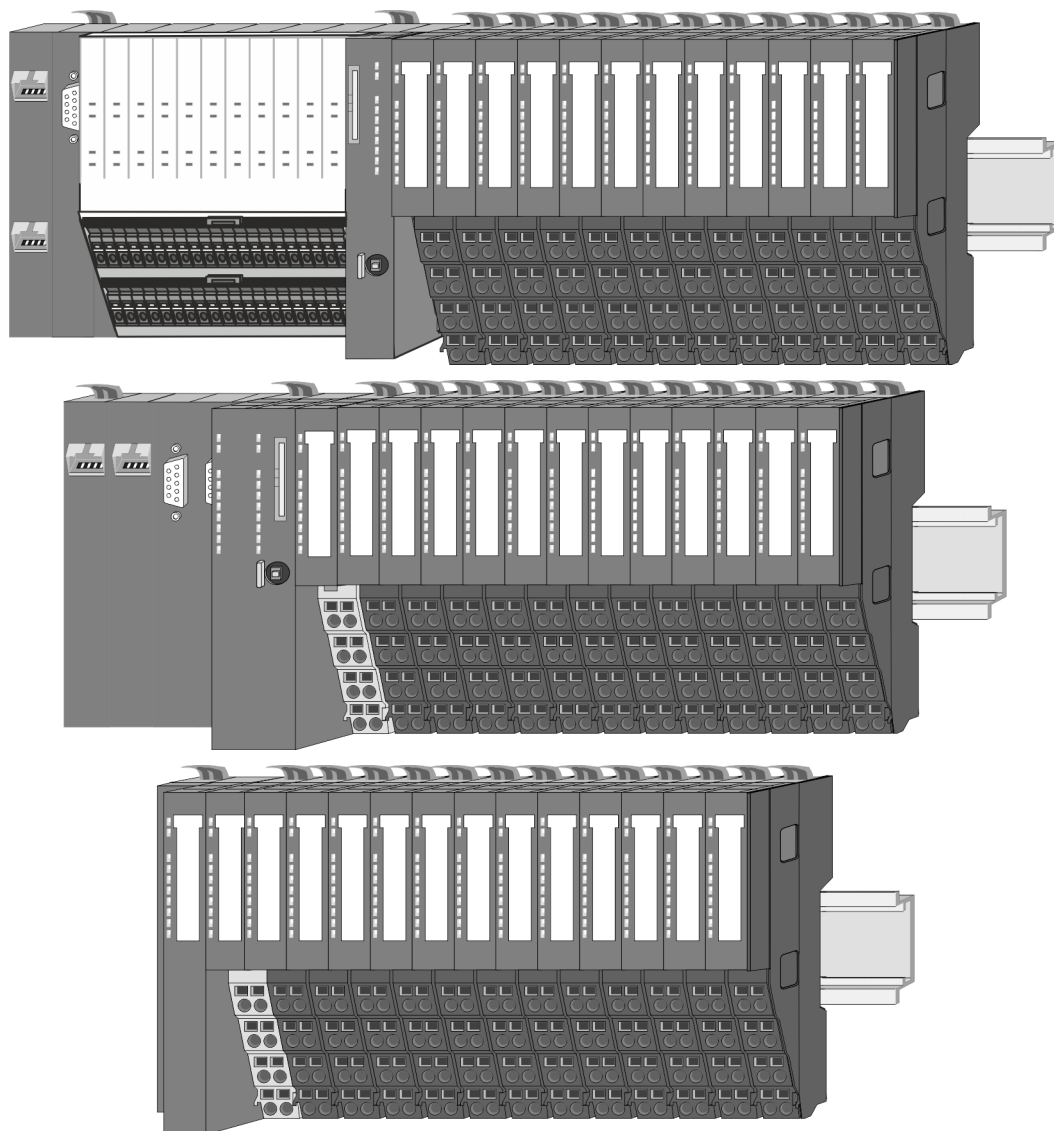

## 2.2.2 Components


- CPU (head module)
- Bus coupler (head module)
- Line extension
- 8x periphery modules
- 16x periphery modules
- Power modules
- Accessories



### CAUTION


Only Yaskawa modules may be combined. A mixed operation with third-party modules is not allowed!

### CPU 01xC

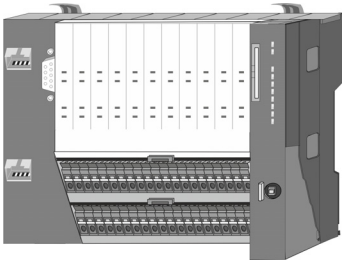

With the CPU 01xC electronic, input/output components and power supply are integrated to one casing. In addition, up to 64 periphery modules of the System SLIO can be connected to the backplane bus. As head module via the integrated power module for power supply CPU electronic and the I/O components are supplied as well as the electronic of the periphery modules, which are connected via backplane bus. To connect the power supply of the I/O components and for DC 24V power section supply of via backplane bus connected periphery modules, the CPU has removable connectors. By installing of up to 64 periphery modules at the backplane bus, these are electrically connected, this means these are assigned to the backplane bus, the electronic modules are power supplied and each periphery module is connected to the DC 24V power section supply.

### CPU 01x

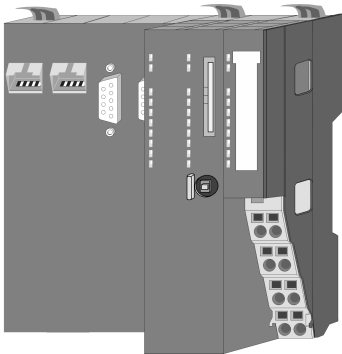

With this CPU 01x, CPU electronic and power supply are integrated to one casing. As head module, via the integrated power module for power supply, CPU electronic and the electronic of the connected periphery modules are supplied. The DC 24V power section supply for the linked periphery modules is established via a further connection of the power module. By installing of up to 64 periphery modules at the backplane bus, these are electrically connected, this means these are assigned to the backplane bus, the electronic modules are power supplied and each periphery module is connected to the DC 24V power section supply.




### CAUTION

CPU part and power module may not be separated!

Here you may only exchange the electronic module!

### Bus coupler

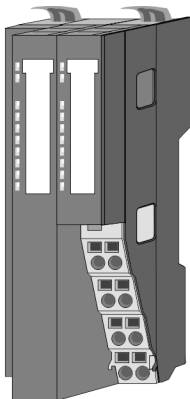

With a bus coupler bus interface and power module is integrated to one casing. With the bus interface you get access to a subordinated bus system. As head module, via the integrated power module for power supply, bus interface and the electronic of the connected periphery modules are supplied. The DC 24V power section supply for the linked periphery modules is established via a further connection of the power module. By installing of up to 64 periphery modules at the bus coupler, these are electrically connected, this means these are assigned to the backplane bus, the electronic modules are power supplied and each periphery module is connected to the DC 24V power section supply.




### CAUTION

Bus interface and power module may not be separated!

Here you may only exchange the electronic module!

### Line extension

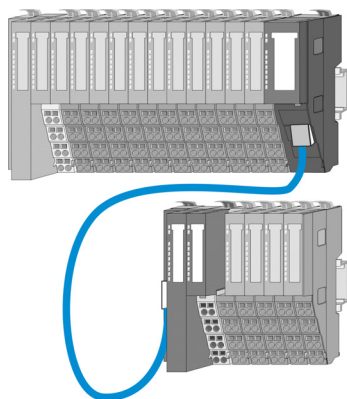


In the System SLIO there is the possibility to place up to 64 modules in on line. By means of the line extension you can divide this line into several lines. Here you have to place a line extension MainDevice at each end of a line and the subsequent line has to start with a line extension SubDevice. MainDevice and SubDevice are to be connected via a special connecting cable. In this way, you can divide a line on up to 5 lines. Depending on the line extension, the max. number of pluggable modules at the System SLIO bus is decreased accordingly. To use the line extension no special configuration is required.



*Please note that some modules do not support line extensions due to the system. For more information, please refer to the compatibility list. This can be found in the 'Download Center' of [www.yaskawa.eu.com](http://www.yaskawa.eu.com) under 'System SLIO Compatibility list'.*

### Periphery modules

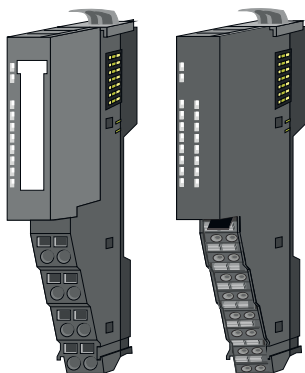


The periphery modules are available in the following 2 versions, whereby of each the electronic part can be replaced with standing wiring:


- 8x periphery module for a maximum of 8 channels.
- 16x periphery module for a maximum of 16 channels.

### 8x periphery modules


Each 8x periphery module consists of a *terminal* and an *electronic module*.

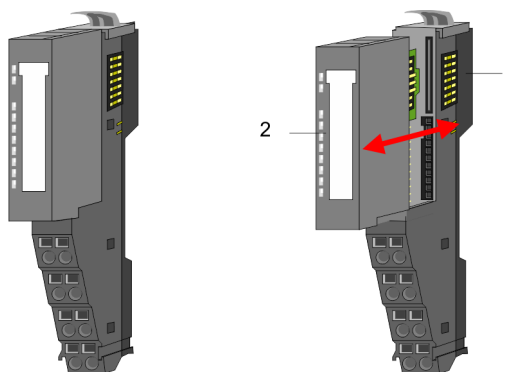

- 1 Terminal module
- 2 Electronic module

**Terminal module**


The *terminal module* serves to carry the electronic module, contains the backplane bus with power supply for the electronic, the DC 24V power section supply and the staircase-shaped terminal for wiring. Additionally the terminal module has a locking system for fixing at a profile rail. By means of this locking system your system may be assembled outside of your switchgear cabinet to be later mounted there as whole system.

**Electronic module**


The functionality of a periphery module is defined by the *electronic module*, which is mounted to the terminal module by a sliding mechanism. With an error the defective electronic module may be exchanged for a functional module with standing installation. At the front side there are LEDs for status indication. For simple wiring each module shows corresponding connection information at the front and at the side.

**16x periphery modules**

Each 16x periphery module consists of an *electronic unit* and a *terminal block*.

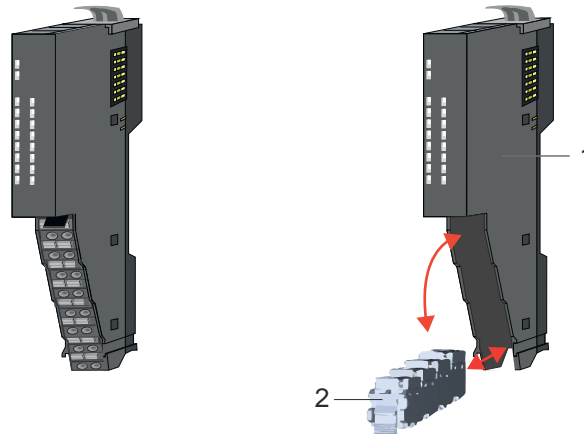

- 1 Electronic unit
- 2 Terminal block

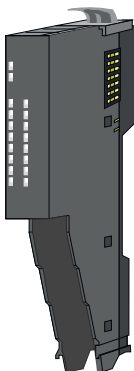**Electronic unit**

With the 16x periphery module the terminal block is connected to the *electronic unit* via a secure flap mechanism. In the case of an error you can exchange the defective electronic unit for a functional unit with standing wiring. At the front side there are LEDs for status indication. For easy wiring each electronic unit shows corresponding connection information at the side. The electronic unit provides the slot for the terminal block for the wiring and contains the backplane bus with power supply for the electronic and the connection to the DC 24V power section supply. Additionally the electronic unit has a locking system for fixing it at a profile rail. By means of this locking system your system may be assembled outside of your switchgear cabinet to be later mounted there as whole system.




### Terminal block



The *terminal block* provides the electrical interface for the signalling and supplies lines of the module. When mounting the terminal block, it is attached to the bottom of the electronic unit and turned towards the electronic unit until it clicks into place. With the wiring a "push-in" spring-clip technique is used. This allows a quick and easy connection of your signal and supply lines. The clamping off takes place by means of a screwdriver.

### Power module

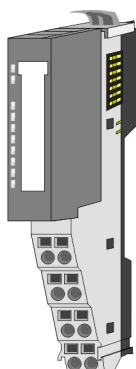

In the System SLIO the power supply is established by power modules. These are either integrated to the head module or may be installed between the periphery modules. Depending on the power module isolated areas of the DC 24V power section supply may be defined respectively the electronic power supply may be extended with 2A. For better recognition the colour of the power modules are contrasting to the periphery modules.

## 2.2.3 Accessories

### Profile rail



| Order no. | Description                      |
|-----------|----------------------------------|
| 290-1AF00 | 35 mm profile rail length 2000mm |
| 290-1AF30 | 35 mm profile rail length 530mm  |



#### NOTICE

**To ensure EMC, the profile rail must be grounded!**

- Ensure that the profile rail is reliably and professionally grounded.
- By mounting them on the grounded profile rail, the modules are automatically connected to the grounding system.


[‘Grounding guidelines’...page 21](#)

[‘Installation guidelines’...page 35](#)

### Shield bus carrier




*Please note that a shield bus carrier cannot be mounted on a 16x periphery module!*

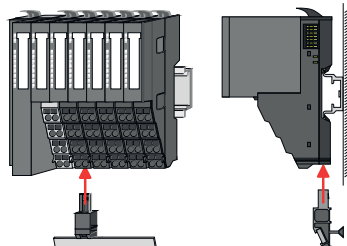

The shield bus carrier (order no.: 000-0AB00) serves to carry the shield bus (10mm x 3mm) to connect cable shields. Shield bus carriers, shield bus and shield fixings are not in the scope of delivery. They are only available as accessories. The shield bus carrier is mounted underneath the terminal of the terminal module. With a flat profile rail for adaptation to a flat profile rail you may remove the spacer of the shield bus carrier.



Bus cover



With each head module, to protect the backplane bus connectors, there is a mounted bus cover in the scope of delivery. You have to remove the bus cover of the head module before mounting a System SLIO module. For the protection of the backplane bus connector you always have to mount the bus cover at the last module of your system again. The bus cover has the order no. 000-0AA00.

Coding pins





*Please note that a coding pin cannot be installed on a 16x periphery module! Here you have to make sure that the associated terminal block is plugged again when the electronics unit is replaced.*

There is the possibility to fix the assignment of electronic and terminal module. Here coding pins (order number 000-0AC00) can be used. The coding pin consists of a coding jack and a coding plug. By combining electronic and terminal module with coding pin, the coding jack remains in the electronic module and the coding plug in the terminal module. This ensures that after replacing the electronic module just another electronic module can be plugged with the same encoding.

Spare parts

The following spare parts are available for the System SLIO:

| Spare part  | Order no. | Description  | Packaging unit |
|---|-----------|--|----------------|
|  | 092-9BH00 | Terminal block for System SLIO 16x periphery module. | 5 pieces       |
|  | 092-9BK00 | Connector for System SLIO CPU 013C.                  | 5 pieces       |




**CAUTION**  
Please note that you may only use the spare parts with Yaskawa modules. Use with third-party modules is not allowed!

## 2.2.4 Hardware revision

### Hardware revision on the front

- The hardware revision is printed on every System SLIO module.
- Since a System SLIO 8x peripheral module consists of a terminal and electronic module, you will find a hardware revision printed on each of them.
- Authoritative for the hardware revision of a System SLIO module is the hardware revision of the electronic module. This is located under the labeling strip of the corresponding electronic module.
- Depending on the module type, there are the following 2 variants e.g. to indicate hardware revision 1:
  - With current labelling there is a **1** on the front.
  - With earlier labelling, the 1 is marked with 'X' on a number grid.

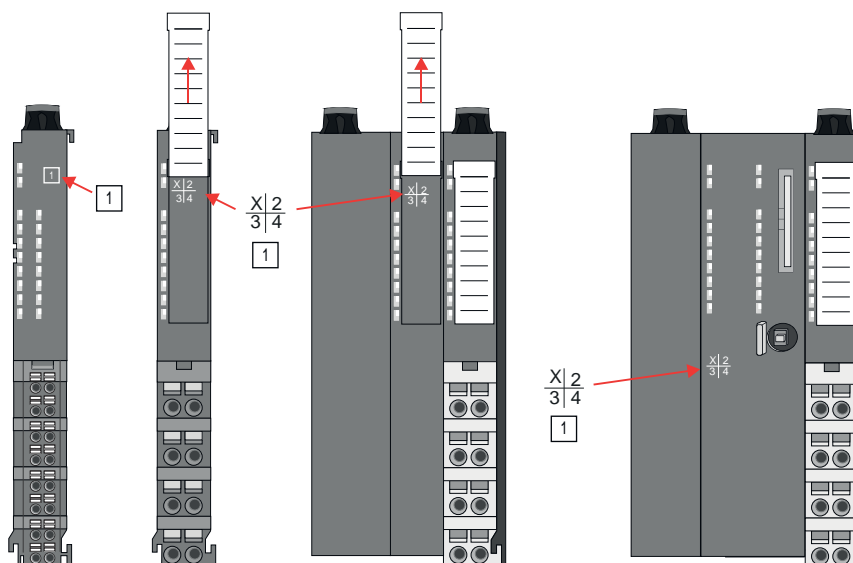


### Hardware revision via web server

On the CPUs and some bus couplers, you can check the hardware revision 'HW Revision' via the integrated web server.

## 2.3 Dimensions

### CPU 01xC


All dimensions are in mm.

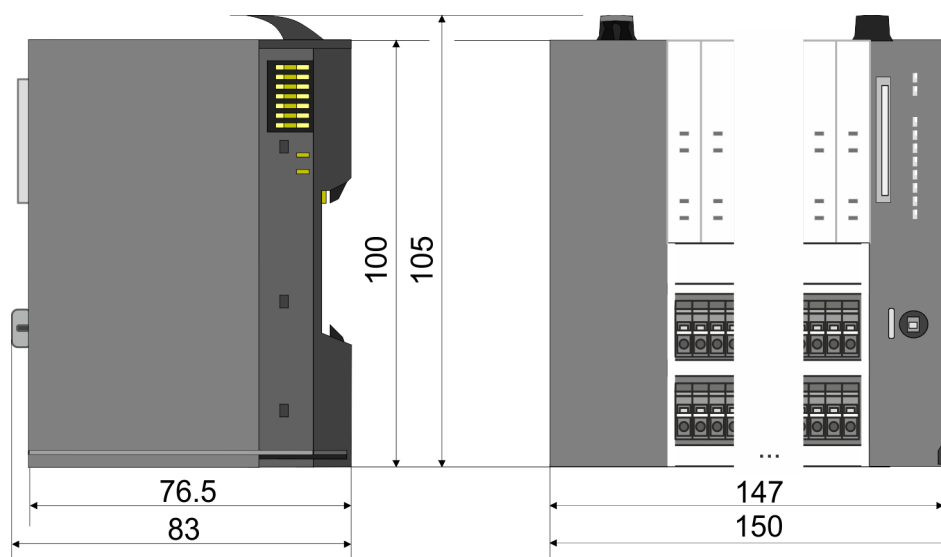


CPU 01x



Bus coupler and line extension SubDevice

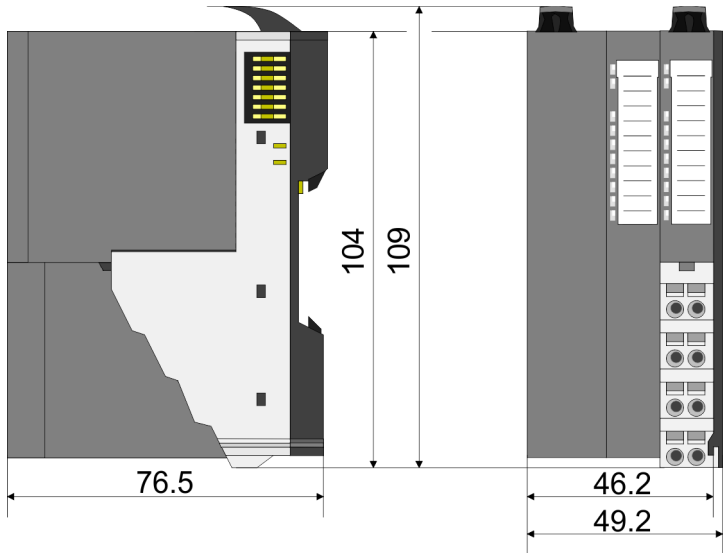


Line extension MainDevice

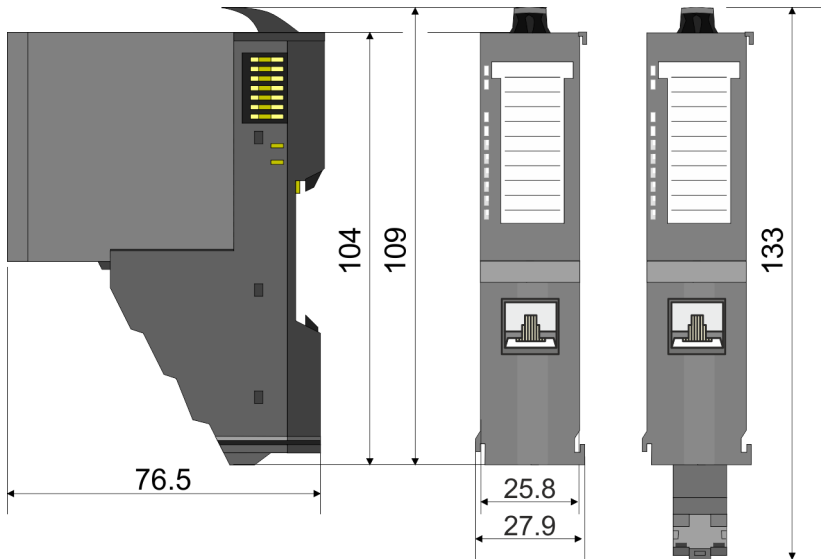


Dimensions


8x periphery module

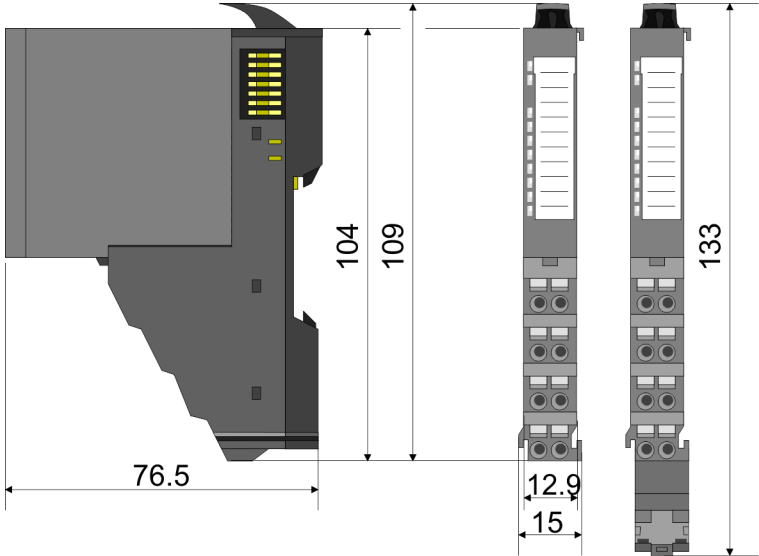

Electronic module

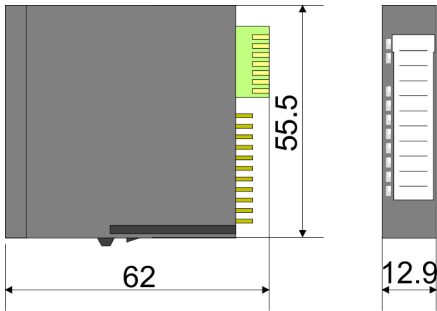

16x periphery module

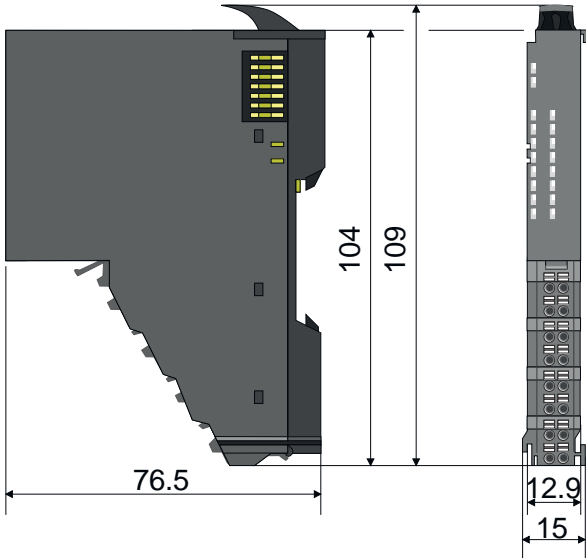

## 2.4 Grounding concept

### Grounding guidelines

For reliable grounding, ensure that all common ground connections and the functional earth (FE) of your System SLIO and all connected devices are connected to a central point and grounded there.



#### NOTICE

**To ensure EMC, the profile rail must be grounded!**

- Ensure that the profile rail is reliably and professionally grounded.
- By mounting them on the grounded profile rail, the modules are automatically connected to the grounding system.


*'Installation guidelines'...page 35*

- To avoid potential differences, use grounding cables that are as short as possible and have a large cross-section.
- When selecting grounding points, observe the applicable safety regulations.
- When assembling your components, ensure that the inactive metal parts are properly grounded over a large area.
  - Connect all inactive metal parts over a large area and with low impedance.
  - Avoid using aluminium parts if possible. Aluminium is easily oxidizing and is therefore less suitable for grounding.

### 2.4.1 Shielding

#### Overview


Shielding is required for interference-free signal transmission. This weakens electrical, magnetic or electromagnetic interference fields. To attach the shield the mounting of shield bus carriers are necessary. The shield bus carrier (available as accessory) serves to carry the shield bus to connect cable shields. *'Installation guidelines'...page 35*

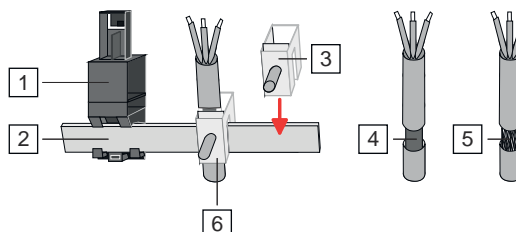


- [1] Shield bus carrier
- [2] Shield bus (10mm x 3mm)
- [3] Shield clamp
- [4] Cable shield with metal foil
- [5] Cable shield with wire mesh (close-meshed)
- [6] Cable shield mounted with shield clamp

### Shield attachment

1. → System SLIO head and 8x periphery modules have a carrier hole for the shield bus carrier. Push the shield bus carrier, until they engage into the module. With a flat profile rail for adaptation to a flat profile rail you may remove the spacer of the shield bus carrier.
2. → Put your shield bus into the shield bus carrier.

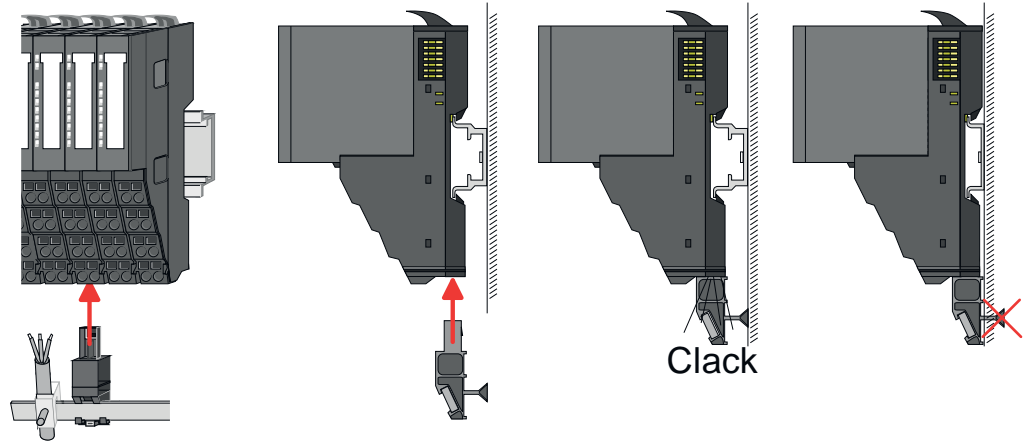

3. → Attach the cables with the accordingly stripped cable screen and fix it by the shield clamp with the shield bus.
4. → The shield bus must always be grounded. Keep all cable connections as short as possible. To ground the shield bus, connect a FE conductor to the shield bus via a shield clamp and screw it to the base plate as close as possible and with low impedance.

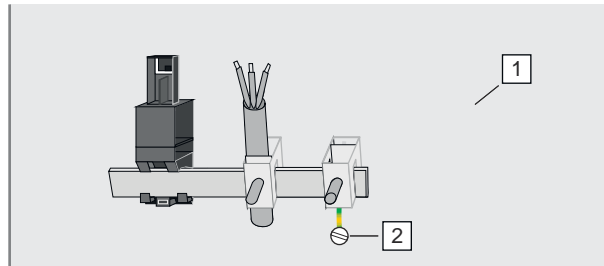

- 1 Base plate
- 2 FE conductor screwed to base plate

## 2.5 Mounting line extension




- By means of the line extension 1 line of modules can be divided to maximum 5 lines.
- For each line extension the maximum number of pluggable modules at the System SLIO bus is decreased:
  - with 06x-1xA00 by 1 module.
  - with 06x-1xA01 by 2 modules.
- The line extension MainDevice is to be placed at the end of the line.
- After the MainDevice the line has to start with a line extension SubDevice.
- Line extension modules are not considered in the listing of the integrated web page of the coupler or CPU respectively the allocation of the slots.
- The usage of additional power modules within a line is allowed.
- To use the line extension no special configuration is required.


### 2.5.1 Mounting line extension MainDevice

#### Proceeding


1. ➤ There is a locking lever at the top side of the line extension MainDevice. For mounting and demounting this locking lever is to be turned upwards until this engages. Turn the locking lever upwards.

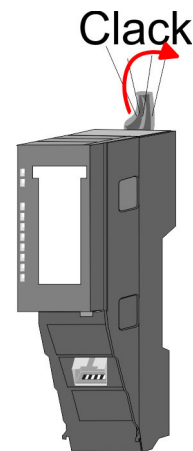

2. ➤ For mounting place the line extension MainDevice to the module installed before in the line and push the line extension MainDevice to the profile rail guided by the strips at the upper and lower side of the module.

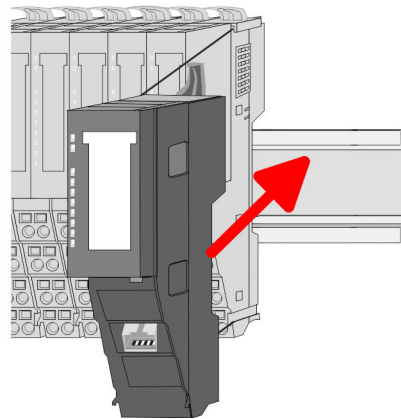

3. ➤ Turn the locking lever of the line extension MainDevice downward, again.

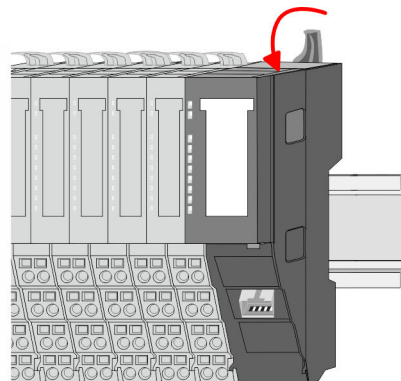


## 2.5.2 Mounting line extension SubDevice

### Proceeding

1. ➔ Mount the profile rail! Please consider that a clearance from the middle of the profile rail of at least 80mm above and 60mm below, respectively 80mm by deployment of shield bus carriers, exist.




2. ➔ There is a locking lever at the top side of the line extension SubDevice. For mounting and demounting these locking lever are to be turned upwards until these engage. Turn the locking lever upwards, place the line extension SubDevice at the profile rail and turn the lever downward.

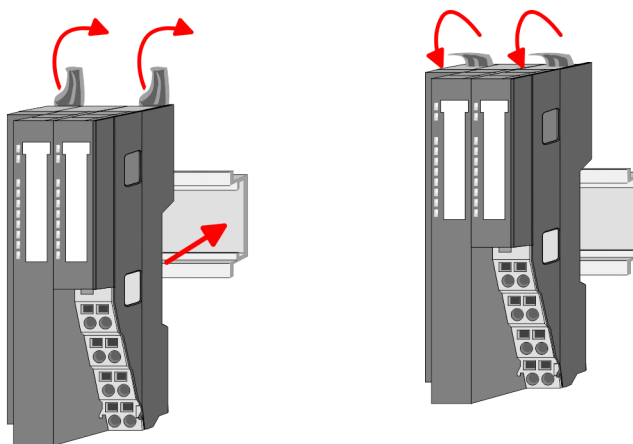






**Mounting of the periphery modules**

1. ➤ Before mounting the periphery modules you have to remove the bus cover at the right side of the line extension SubDevice by pulling it forward. Keep the cover for later mounting.

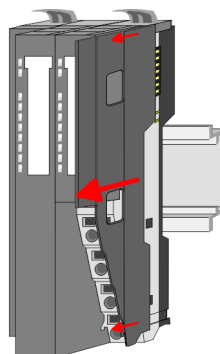



2. ➤ Mount the periphery modules you want.

**Clack**

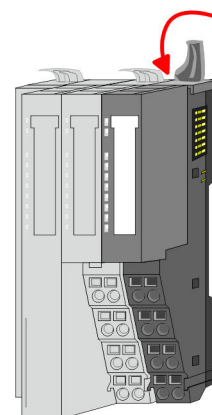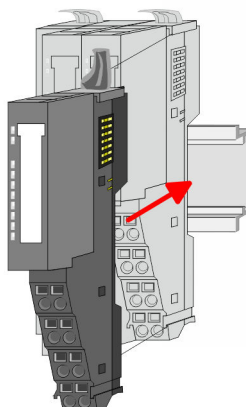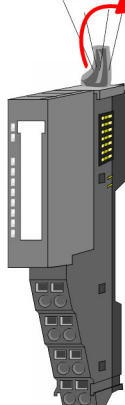

- The electronic and power section supply are connected via the backplane bus. Please consider here that the sum current of the electronic power supply does not exceed the maximum value of 3A. By means of the power module 007-1AB10 the current of the electronic power supply may be expanded accordingly.

3. ➤ For more line extensions '[Mounting line extension MainDevice'...page 23](#)
4. ➤ After mounting the whole system, to protect the backplane bus connectors at the last module you have to mount the bus cover, now. If the last module is a clamp module, for adaptation the upper part of the bus cover is to be removed.

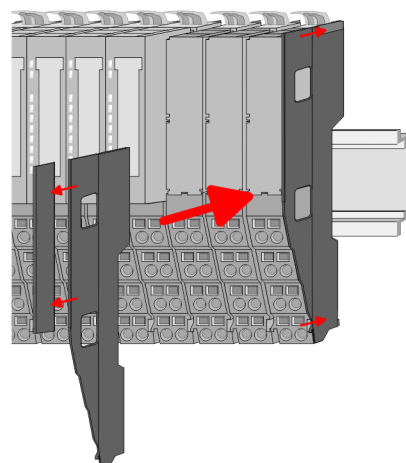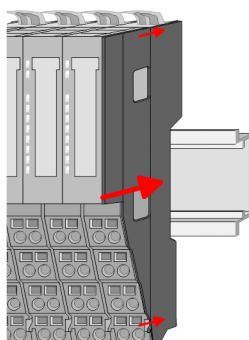

## 2.6 Wiring line extension

### 2.6.1 Wiring line extension MainDevice


Since the line extension MainDevice is supplied via the power section supply of the backplane bus, an additional wiring is not required.

### 2.6.2 Wiring line extension SubDevice

#### Terminal module terminals

Der line extension SubDevice has an integrated power module. Terminals with spring clamp technology are used for wiring. The spring clamp technology allows quick and easy connection of your signal and supply lines. In contrast to screw terminal connections this type of connection is vibration proof.


#### Data





Please use copper wire only!

$U_{max}$  30V DC  
 $I_{max}$  10A  
 Cross section 0.08 ... 1.5mm<sup>2</sup> (AWG 28 ... 16)  
 Stripping length 10mm

#### Wiring procedure




- 1 Pin no. at the connector
- 2 Opening for screwdriver
- 3 Connection hole for wire

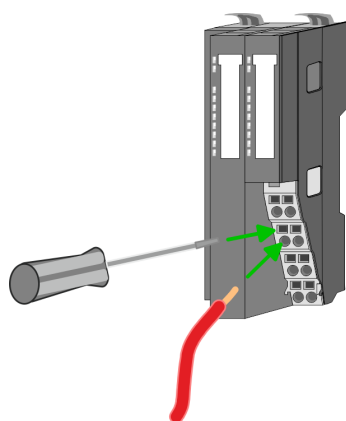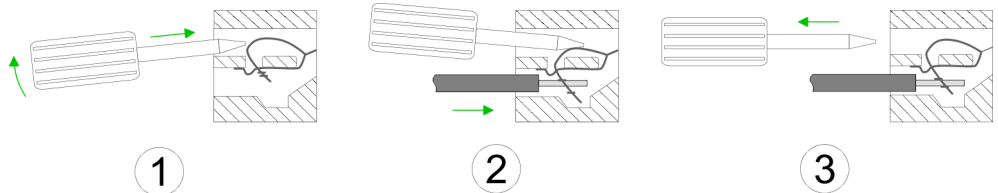


1. Insert a suited screwdriver at an angle into the square opening as shown. Press and hold the screwdriver in the opposite direction to open the contact spring.
2. Insert the stripped end of wire into the round opening. You can use wires with a cross section of 0.08mm<sup>2</sup> up to 1.5mm<sup>2</sup>.
3. By removing the screwdriver, the wire is securely fixed via the spring contact to the terminal.

Standard wiring

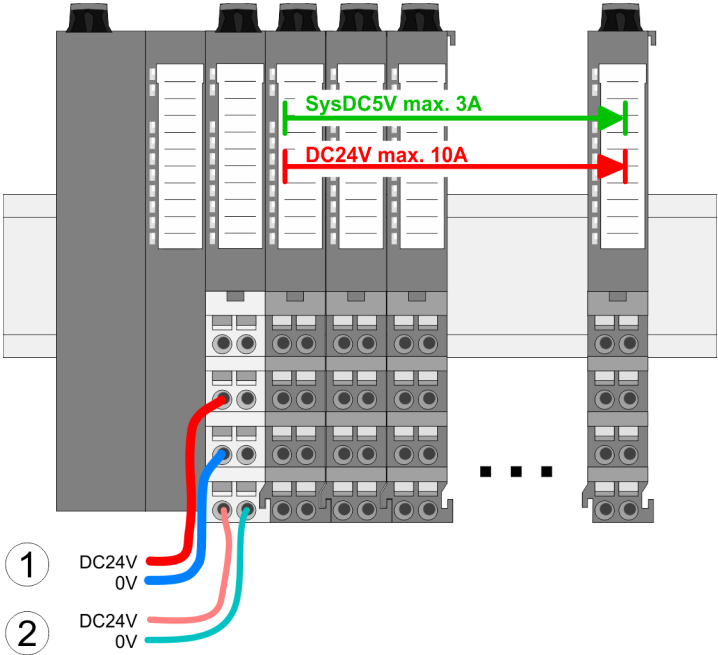

- (1) DC 24V for power section supply I/O area (max. 10A)
- (2) DC 24V for electronic section supply line extension SubDevice and I/O area.

PM - Power module

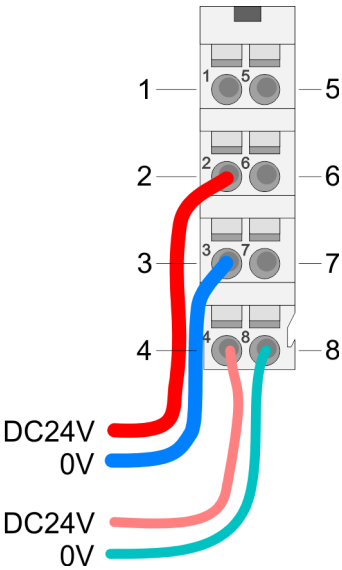

For wires with a core cross-section of 0.08mm² up to 1.5mm².

| Pos. | Function   | Type | Description                        |
|------|------------|------|------------------------------------|
| 1    | ---        | ---  | not connected                      |
| 2    | DC 24V     | I    | DC 24V for power section supply    |
| 3    | 0V         | I    | GND for power section supply       |
| 4    | Sys DC 24V | I    | DC 24V for electronic power supply |
| 5    | ---        | ---  | not connected                      |
| 6    | DC 24V     | I    | DC 24V for power section supply    |
| 7    | 0V         | I    | GND for power section supply       |
| 8    | Sys 0V     | I    | GND for electronic power supply    |

I: Input



CAUTION

Since the power section supply is not internally protected, it is to be externally protected with a fuse, which corresponds to the maximum current. This means max. 10A is to be protected by a 10A fuse (fast) respectively by a line circuit breaker 10A characteristics Z and should be UL approved!



The electronic power section supply is internally protected against higher voltage by fuse. The fuse is within the power module. If the fuse releases, its electronic module must be exchanged!

**Fusing**

- The power section supply is to be externally protected with a fuse, which corresponds to the maximum current. This means max. 10A is to be protected with a 10A fuse (fast) respectively by a line circuit breaker 10A characteristics Z and should be UL approved.
  - For modules with positive logic (PNP), place the fuse on the positive connector.
  - For modules with negative logic (NPN), place the fuse on the negative connector.
  - For mixed logic, one fuse must be placed on the negative and one on the positive connector.
- It is recommended to externally protect the electronic power supply for line extension SubDevice and I/O area with a 2A fuse (fast) respectively by a line circuit breaker 2A characteristics Z and should be UL approved.
- The electronic power supply for the I/O area of the power module 007-1AB10 should also be externally protected with a 1A fuse (fast) respectively by a line circuit breaker 1A characteristics Z and should be UL approved.

**State of the electronic power supply via LEDs**

After PowerON of the System SLIO the LEDs RUN respectively MF get on so far as the sum current does not exceed 3A. With a sum current greater than 3A the LEDs may not be activated. Here the power module with the order number 007-1AB10 is to be placed between the peripheral modules.

### 2.6.3 Line extension - connection cable

#### Cabling




#### CAUTION

When 06x-1xA00 used - version 1:

- Please use connection cables from Yaskawa for connection. The use of normal Ethernet cable can cause damage!
- The connection cable must not exceed the maximum length of 2m.
- The connection cable between MainDevice and SubDevice may be plugged or removed only when the modules are powered off.

When 06x-1xA01 used - version 2:

- The use of connection cables from Yaskawa is recommended. You can also use Ethernet cables with the specification S/STP CAT6a or S/FTP CAT6a.
- The connection cable must not exceed the maximum length of 10m.
- The connection cable between MainDevice and SubDevice may be plugged or removed only when the modules are powered off.

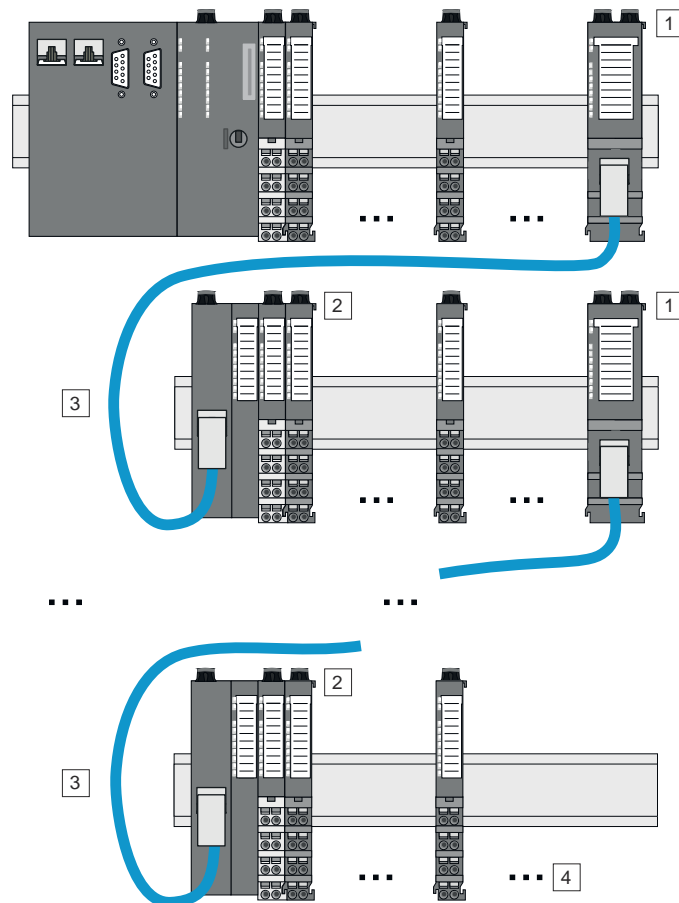


- 1 Line extension MainDevice
- 2 Line extension SubDevice
- 3 Connection cable
- 4 Depending on the line extension used, the max. number of pluggable modules on the System SLIO bus is reduced accordingly.


## 2.7 Demounting line extension

### 2.7.1 Demounting line extension MainDevice


#### Proceeding

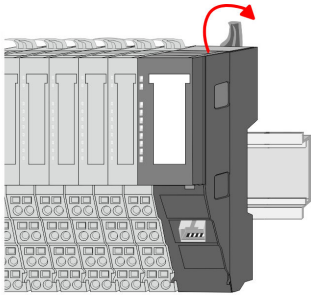


1. ➤ Power-off your system.
2. ➤ Remove if exists the connection cable at line extension MainDevice.
3. ➤ Turn the locking lever of the line extension MainDevice to be exchanged upwards.

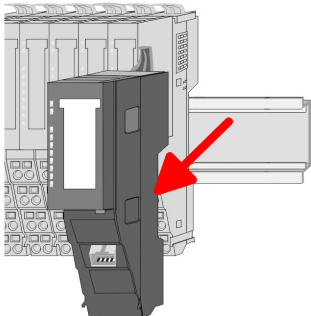

4. ➤ Pull the line extension MainDevice forward.

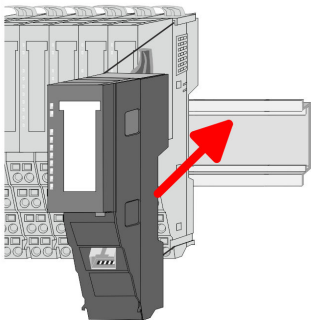


5. ➤ For mounting turn the locking lever of the line extension MainDevice upward until it engages.
6. ➤ For mounting place the line extension MainDevice to the module installed before in the line and push the line extension MainDevice to the profile rail guided by the strips at the upper and lower side of the module.

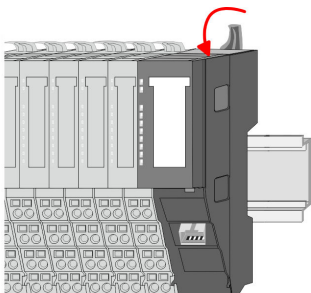

7. ➤ Turn the locking lever of the line extension MainDevice downward, again.
8. ➤ Plug again the connection cable.
  - ➔ Now you can bring your system back into operation.

## 2.7.2 Demounting line extension SubDevice

### Proceeding




1. ➤ Power-off your system.
2. ➤ Remove if exists the connection cable at line extension SubDevice.
3. ➤




*For demounting and exchange of a (head) module or a group of modules, due to mounting reasons you always have to remove the electronic module right beside. After mounting it may be plugged again.*

Press the unlocking lever at the lower side of the just mounted right module near the line extension SubDevice and pull it forward.

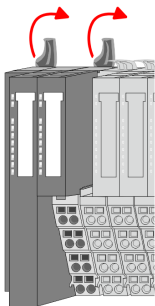

4. ➤ Turn all the locking lever of the line extension SubDevice to be exchanged upwards.

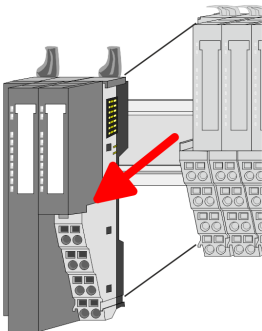


5. ➤ Pull the line extension SubDevice forward.




#### CAUTION

Line extension interface and power module of the line extension SubDevice may not be separated! Here you may only exchange the electronic module!

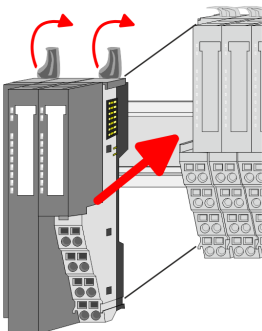

6. ➤ For mounting turn all the locking lever of the line extension SubDevice to be exchanged upwards.
7. ➤ To mount the line extension SubDevice put it to the left periphery module and push the line extension SubDevice, guided by the stripes, to the profile rail.



8. ➤ Turn all the locking lever downward, again.
  9. ➤ Plug again the electronic module, which you have removed before.
  10. ➤ Plug again the connection cable.
- ➡ Now you can bring your system back into operation.


## 2.8 Trouble shooting - LEDs

### General

Each module has the LEDs RUN and MF on its front side. Errors or incorrect modules may be located by means of these LEDs.

In the following illustrations flashing LEDs are marked by ☼.

### Sum current of the electronic power supply exceeded

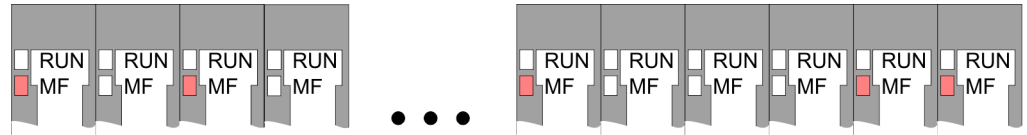


**Behavior:** After PowerON the RUN LED of each module is off and the MF LED of each module is sporadically on.

**Reason:** The maximum current for the electronic power supply is exceeded.

**Remedy:** As soon as the sum current of the electronic power supply is exceeded, always place the power module 007-1AB10.

### Error in configuration

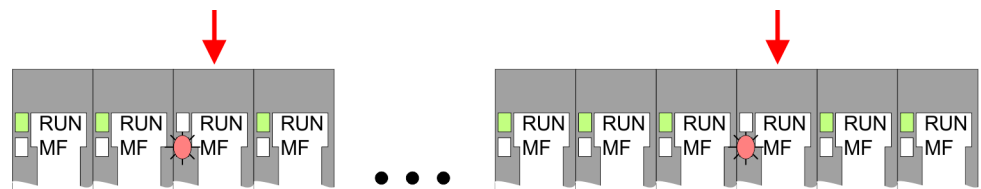


**Behavior:** After PowerON the MF LED of one module respectively more modules flashes. The RUN LED remains off.

**Reason:** At this position a module is placed, which does not correspond to the configured module.

**Remedy:** Match configuration and hardware structure.

### Module failure

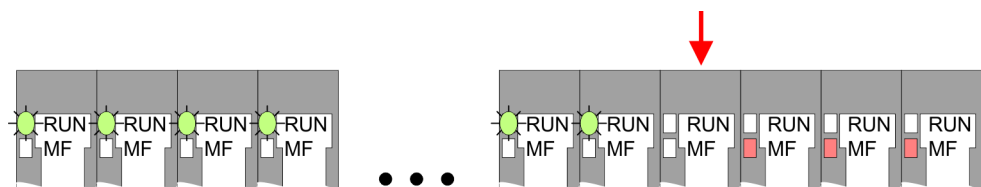

**Behavior:** After PowerON all of the RUN LEDs up to the defective module are flashing. With all following modules the MF LED is on and the RUN LED is off.

**Reason:** The module on the right of the flashing modules is defective.

**Remedy:** Replace the defective module.



## 2.9 Industrial security and installation guidelines

### 2.9.1 Industrial security in information technology

#### Latest version

This chapter can also be found as a guide '*Industrial IT Security*' in the '*Download Center*' of [www.yaskawa.eu.com](http://www.yaskawa.eu.com)

#### Hazards

The topic of data security and access protection has become increasingly important in the industrial environment. The increased networking of entire industrial systems to the network levels within the company together with the functions of remote maintenance have all served to increase vulnerability. Hazards can arise from:

- Internal manipulation such as technical errors, operating and program errors and deliberate program or data manipulation.
- External manipulation such as software viruses, worms and trojans.
- Human carelessness such as password phishing.

#### Precautions

The most important precautions to prevent manipulation and loss of data security in the industrial environment are:

- Encrypting the data traffic by means of certificates.
- Filtering and inspection of the traffic by means of VPN - "Virtual Private Networks".
- Identification of the user by "Authentication" via save channels.
- Segmenting in protected automation cells, so that only devices in the same group can exchange data.
- Deactivation of unnecessary hardware and software.

#### Further Information

You can find more information about the measures on the following websites:

- Federal Office for Information Technology ➔ [www.bsi.bund.de](http://www.bsi.bund.de)
- Cybersecurity & Infrastructure Security Agency ➔ [us-cert.cisa.gov](http://us-cert.cisa.gov)
- VDI / VDE Society for Measurement and Automation Technology ➔ [www.vdi.de](http://www.vdi.de)

### 2.9.1.1 Protection of hardware and applications

#### Precautions

- Do not integrate any components or systems into public networks.
  - Use VPN "Virtual Private Networks" for use in public networks. This allows you to control and filter the data traffic accordingly.
- Always keep your system up-to-date.
  - Always use the latest firmware version for all devices.
  - Update your user software regularly.
- Protect your systems with a firewall.
  - The firewall protects your infrastructure internally and externally.
  - This allows you to segment your network and isolate entire areas.
- Secure access to your plants via user accounts.
  - If possible, use a central user management system.
  - Create a user account for each user for whom authorization is essential.
  - Always keep user accounts up-to-date and deactivate unused user accounts.
- Secure access to your plants via secure passwords.
  - Change the password of a standard login after the first start.
  - Use strong passwords consisting of upper/lower case, numbers and special characters. The use of a password generator or manager is recommended.
  - Change the passwords according to the rules and guidelines that apply to your application.
- Deactivate inactive communication ports respectively protocols.
  - Only the communication ports that are used for communication should be activated.
  - Only the communication protocols that are used for communication should be activated.
- Consider possible defence strategies when planning and securing the system.
  - The isolation of components alone is not sufficient for comprehensive protection. An overall concept is to be drawn up here, which also provides defensive measures in the event of a cyber attack.
  - Periodically carry out threat assessments. Among others, a comparison is made here between the protective measures taken and those required.
- Limit the use of external storage media.
  - Via external storage media such as USB memory sticks or SD memory cards, malware can get directly into a system while bypassing a firewall.
  - External storage media or their slots must be protected against unauthorized physical access, e.g. by using a lockable control cabinet.
  - Make sure that only authorized persons have access.
  - When disposing of storage media, make sure that they are safely destroyed.
- Use secure access paths such as HTTPS or VPN for remote access to your plant.
- Enable security-related event logging in accordance with the applicable security policy and legal requirements for data protection.

### 2.9.1.2 Protection of PC-based software

#### Precautions

Since PC-based software is used for programming, configuration and monitoring, it can also be used to manipulate entire systems or individual components. Particular caution is required here!

- Use user accounts on your PC systems.
  - If possible, use a central user management system.
  - Create a user account for each user for whom authorization is essential.
  - Always keep user accounts up-to-date and deactivate unused user accounts.
- Protect your PC systems with secure passwords.
  - Change the password of a standard login after the first start.
  - Use strong passwords consisting of upper/lower case, numbers and special characters. The use of a password generator or manager is recommended.
  - Change the passwords according to the rules and guidelines that apply to your application.
- Enable security-related event logging in accordance with the applicable security policy and legal requirements for data protection.
- Protect your PC systems by security software.
  - Install virus scanners on your PC systems to identify viruses, trojans and other malware.
  - Install software that can detect phishing attacks and actively prevent them.
- Always keep your software up-to-date.
  - Update your operating system regularly.
  - Update your software regularly.
- Make regular backups and store the media at a safe place.
- Regularly restart your PC systems. Only boot from storage media that are protected against manipulation.
- Use encryption systems on your storage media.
- Perform security assessments regularly to reduce the risk of manipulation.
- Use only data and software from approved sources.
- Uninstall software which is not used.
- Disable unused services.
- Activate a password-protected screen lock on your PC systems.
- Always lock your PC systems as soon as you leave your PC workstation.
- Do not click any links that come from unknown sources. If necessary ask, e.g. on e-mails.
- Use secure access paths such as HTTPS or VPN for remote access to your PC system.

### 2.9.2 Installation guidelines

#### General

The installation guidelines contain information about the interference free deployment of a PLC system. There is the description of the ways, interference may occur in your PLC, how you can make sure the electromagnetic compatibility (EMC), and how you manage the isolation.

#### What does EMC mean?

Electromagnetic compatibility (EMC) means the ability of an electrical device, to function error free in an electromagnetic environment without being interfered respectively without interfering the environment.

The components are developed for the deployment in industrial environments and meets high demands on the EMC. Nevertheless you should project an EMC planning before installing the components and take conceivable interference causes into account.

**Possible interference causes**

Electromagnetic interferences may interfere your control via different ways:

- Electromagnetic fields (RF coupling)
- Magnetic fields with power frequency
- Bus system
- Power supply
- Protected ground conductor

Depending on the spreading medium (lead bound or lead free) and the distance to the interference cause, interferences to your control occur by means of different coupling mechanisms.

There are:

- galvanic coupling
- capacitive coupling
- inductive coupling
- radiant coupling

**Basic rules for EMC**

In the most times it is enough to take care of some elementary rules to guarantee the EMC. Please regard the following basic rules when installing your PLC.

- Take care of a correct area-wide grounding of the inactive metal parts when installing your components.
  - Connect all inactive metal extensive and impedance-low.
  - Please try not to use aluminium parts. Aluminium is easily oxidizing and is therefore less suitable for grounding.
- When cabling, take care of the correct line routing.
  - Organize your cabling in line groups (high voltage, current supply, signal and data lines).
  - Always lay your high voltage lines and signal respectively data lines in separate channels or bundles.
  - Route the signal and data lines as near as possible beside ground areas (e.g. suspension bars, metal rails, tin cabinet).
- Proof the correct fixing of the lead isolation.
  - Data lines must be shielded.
  - Analog lines must be shielded. When transmitting signals with small amplitudes the one sided laying of the isolation may be favourable.
  - Cables for frequency inverters, servo and stepper motors must be shielded.
  - Lay the line isolation extensively on an isolation/protected ground conductor rail directly after the cabinet entry and fix the isolation with cable clamps.
  - Make sure that the isolation/protected ground conductor rail is connected impedance-low with the cabinet.
  - Use metallic or metallised plug cases for isolated data lines.
- In special use cases you should appoint special EMC actions.
  - Consider to wire all inductivities with erase links.
  - Please consider luminescent lamps can influence signal lines.
- Create a homogeneous reference potential and ground all electrical operating supplies when possible.
  - Please take care for the targeted employment of the grounding actions. The grounding of the PLC serves for protection and functionality activity.
  - Connect installation parts and cabinets with your PLC in star topology with the isolation/protected ground conductor system. So you avoid ground loops.
  - If there are potential differences between installation parts and cabinets, lay sufficiently dimensioned potential compensation lines.

**Isolation of conductors**

Electrical, magnetically and electromagnetic interference fields are weakened by means of an isolation, one talks of absorption. Via the isolation rail, that is connected conductive with the rack, interference currents are shunt via cable isolation to the ground. Here you have to make sure, that the connection to the protected ground conductor is impedance-low, because otherwise the interference currents may appear as interference cause.

When isolating cables you have to regard the following:

- If possible, use only cables with isolation tangle.
- The hiding power of the isolation should be higher than 80%.
- Normally you should always lay the isolation of cables on both sides. Only by means of the both-sided connection of the isolation you achieve high quality interference suppression in the higher frequency area. Only as exception you may also lay the isolation one-sided. Then you only achieve the absorption of the lower frequencies. A one-sided isolation connection may be convenient, if:
  - the conduction of a potential compensating line is not possible.
  - analog signals (some mV respectively  $\mu\text{A}$ ) are transferred.
  - foil isolations (static isolations) are used.
- With data lines always use metallic or metallised plugs for serial couplings. Fix the isolation of the data line at the plug rack. Do not lay the isolation on the PIN 1 of the plug bar!
- At stationary operation it is convenient to strip the insulated cable interruption free and lay it on the isolation/protected ground conductor line.
- To fix the isolation tangles use cable clamps out of metal. The clamps must clasp the isolation extensively and have well contact.
- Lay the isolation on an isolation rail directly after the entry of the cable in the cabinet.

**CAUTION**

**Please regard at installation!**

At potential differences between the grounding points, there may be a compensation current via the isolation connected at both sides.

Remedy: Potential compensation line

**2.10 General data for the System SLIO**

| Conformity and approval |               |   |
|-------------------------|---------------|---|
| Conformity              |               |   |
| CE                      | 2014/35/EU    | Low Voltage Directive   |
|                         | 2014/30/EU    | EMC Directive   |
| RoHS (EU)               | 2011/65/EU    | Restriction of the use of certain hazardous substances in electrical and electronic equipment |
| UKCA                    | 2016 No. 1101 | Electrical Equipment (Safety) Regulations   |
|                         | 2016 No. 1091 | Electromagnetic Compatibility Regulations   |
| RoHS (UK)               | 2012 No. 3032 | Use of Certain Hazardous Substances   |
| Approval                |               |   |
| Certifications          | -             | Refer to technical data   |

## General data for the System SLIO

**Protection of persons and device protection**

|  |   |                                   |
|--|---|-----------------------------------|
| Type of protection                     | - | IP20                              |
| Electrical isolation                   |   |                                   |
| to the field bus                       | - | electrically isolated             |
| to the process level                   | - | electrically isolated             |
| Insulation resistance                  | - | -                                 |
| Insulation voltage to reference ground |   |                                   |
| Inputs / outputs                       | - | AC / DC 50V, test voltage AC 500V |
| Protective measures                    | - | against short circuit             |

**Environmental conditions to EN 61131-2**

|                                 |               |  |
|---------------------------------|---------------|--|
| Operation                       |               |  |
| Horizontal installation hanging | EN 61131-2    | 0...+60°C  |
| Horizontal installation lying   | EN 61131-2    | 0...+55°C  |
| Vertical installation           | EN 61131-2    | 0...+50°C  |
| Air humidity                    | EN 60068-2-30 | RH1 (without condensation, rel. humidity 10...95%) |
| Pollution                       | EN 61131-2    | Degree of pollution 2                              |
| Installation altitude max.      | -             | 2000m  |
| Mechanical                      |               |  |
| Oscillation                     | EN 60068-2-6  | 1g, 9Hz ... 150Hz                                  |
| Shock                           | EN 60068-2-27 | 15g, 11ms  |

**Mounting conditions**

|                   |   |                         |
|-------------------|---|-------------------------|
| Mounting place    | - | In the control cabinet  |
| Mounting position | - | Horizontal and vertical |

| EMC                      | Standard     |              | Comment   |
|--------------------------|--------------|--------------|---|
| Emitted interference     | EN 61000-6-4 |              | Class A (Industrial area)   |
| Noise immunity<br>zone B | EN 61000-6-2 | EN 61000-4-2 | Industrial area   |
|                          |              |              | ESD<br>8kV at air discharge (degree of severity 3),<br>4kV at contact discharge (degree of severity 2)        |
|                          |              | EN 61000-4-3 | HF field immunity (casing)<br>80MHz ... 1000MHz, 10V/m, 80% AM (1kHz)<br>1.4GHz ... 6GHz, 3V/m, 80% AM (1kHz) |
|                          |              |              | HF conducted<br>150kHz ... 80MHz, 10V, 80% AM (1kHz)  |
|                          |              | EN 61000-4-4 | Burst   |
|                          |              | EN 61000-4-5 | Surge <sup>1</sup>  |

1) Due to the high-energetic single pulses with Surge an appropriate external protective circuit with lightning protection elements like conductors for lightning and overvoltage is necessary.

2.10.1 Use in difficult operating conditions




***Without additional protective measures, the products must not be used in locations with difficult operating conditions; e.g. due to:***

- *dust generation*
- *chemically active substances (corrosive vapors or gases)*
- *strong electric or magnetic fields*

## 3 Deployment

### 3.1 Properties

#### Line extension 06x-1xA00 - version 1

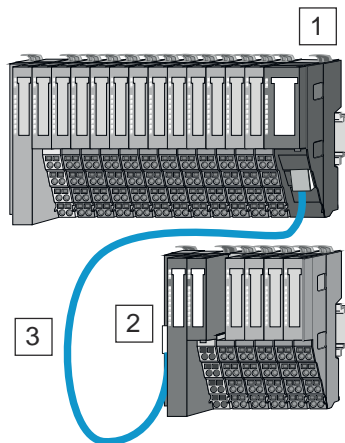


Properties 060-1AA00 Line extension MainDevice [1]:

- Placement at the end of a line
- Possibility to connect a line extension SubDevice 061-1BA00.
- No additional configuration required.
- Status indication via LEDs.

Properties 061-1BA00 Line extension SubDevice [2]:

- Placement at the beginning of a line.
- Connection to line extension MainDevice 060-1AA00 via connection cable [3] from Yaskawa with a maximum length of 2m.
- For each line extension the max. number of pluggable modules is decreased by 1.
- Integrated power supply for power and electronic supply.
- No additional configuration required.
- Status indication via LEDs.

#### Line extension 06x-1xA01 - version 2

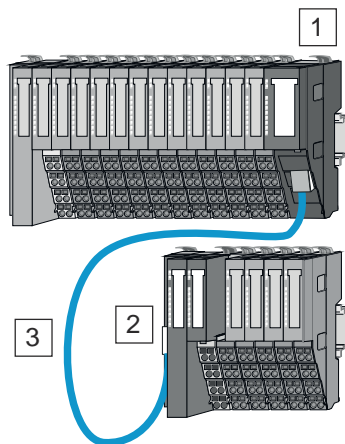

Properties 060-1AA01 Line extension MainDevice [1]:

- Placement at the end of a line.
- Possibility to connect a line extension SubDevice 061-1BA01.
- No additional configuration required.
- Status indication via LEDs.

Properties 061-1BA01 Line extension SubDevice [2]:

- Placement at the beginning of a line.
- Connection to line extension MainDevice 060-1AA01 via connection cable [3] from Yaskawa with a maximum length of 10m.
- For each line extension the max. number of pluggable modules is decreased by 2.
- Integrated power supply for power and electronic supply.
- No additional configuration required.
- Status indication via LEDs.

#### Ordering data

| Type             | Order number            | Description                           |
|------------------|-------------------------|---------------------------------------|
| IM 060           | 060-1AA00               | Line extension MainDevice - version 1 |
|                  | 060-1AA01               | Line extension MainDevice - version 2 |
| IM 061           | 061-1BA00               | Line extension SubDevice - version 1  |
|                  | 061-1BA01               | Line extension SubDevice - version 2  |
| Connection cable | 950-0KD30               | Connection cable 2m length            |
|                  | 950-0KD40 <sup>1)</sup> | Connection cable 5m length            |
|                  | 950-0KD50 <sup>1)</sup> | Connection cable 10m length           |


1) Not suitable for 06x-1xA00.



3.2 Structure

3.2.1 Line extension MainDevice


060-1AA0x

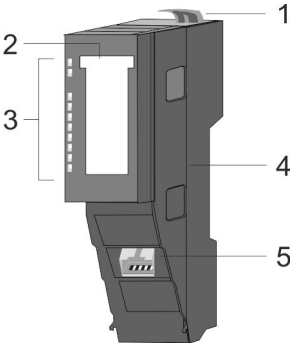

- 1 Locking lever
- 2 Labeling strip line extension
- 3 LED status indication line extension
- 4 Bus cover
- 5 X1: Line extension

3.2.1.1 Interface


X1: Line extension  
X1











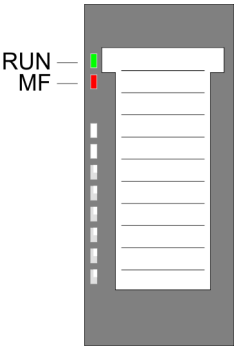


The connection of a line extension SubDevice happens via this interface.

3.2.1.2 LEDs


Line extension MainDevice



| RUN<br><br>green | MF<br><br>red | Description  |
|---|--|--|
|                  |               | Bus communication is OK.<br>Module status is OK.                           |
|                  |               | Bus communication is OK.<br>Module status reports an error.                |
|                  |               | Bus communication is not possible.<br>Module status reports an error.      |
|                  |               | Error at bus power supply.   |
| X   | <br>2Hz       | Error in configuration <a href="#">‘Trouble shooting - LEDs’...page 32</a> |
| not relevant: X   |  |  |


3.2.2 Line extension SubDevice

061-1BA0x

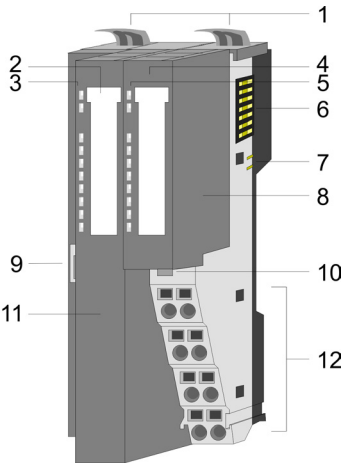


- 1 Locking lever terminal module
- 2 Labeling strip line extension
- 3 LED status indication line extension
- 4 Labelling strip power module
- 5 LED status indication power module
- 6 Backplane bus
- 7 DC 24V power section supply
- 8 Power module
- 9 X1: Line extension
- 10 Unlocking lever power module
- 11 Line extension SubDevice
- 12 Terminal power module

3.2.2.1 Interfaces

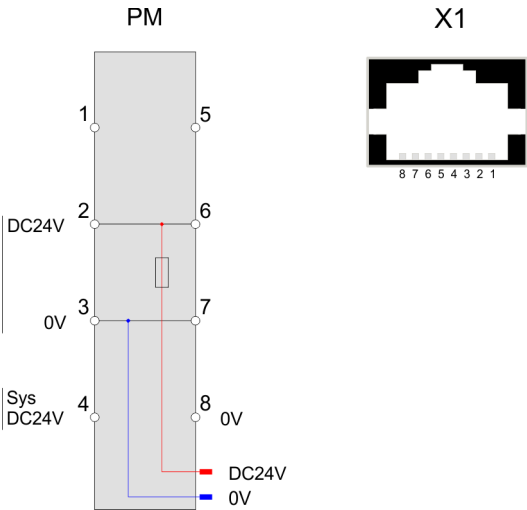

PM - Power module

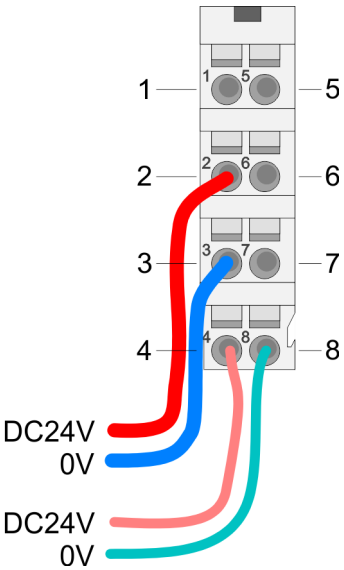


For wires with a core cross-section of 0.08mm² up to 1.5mm².

| Pos. | Function   | Type | Description                        |
|------|------------|------|------------------------------------|
| 1    | ---        | ---  | not connected                      |
| 2    | DC 24V     | I    | DC 24V for power section supply    |
| 3    | 0V         | I    | GND for power section supply       |
| 4    | Sys DC 24V | I    | DC 24V for electronic power supply |
| 5    | ---        | ---  | not connected                      |
| 6    | DC 24V     | I    | DC 24V for power section supply    |
| 7    | 0V         | I    | GND for power section supply       |
| 8    | Sys 0V     | I    | GND for electronic power supply    |

I: Input

**X1: Line extension**

X1



The connection of a superordinate line extension MainDevice happens via this interface.


**CAUTION**

When 06x-1xA00 used - version 1:

- Please use connection cables from Yaskawa for connection. The use of normal Ethernet cable can cause damage!
- The connection cable must not exceed the maximum length of 2m.
- The connection cable between MainDevice and SubDevice may be plugged or removed only when the modules are powered off.

When 06x-1xA01 used - version 2:

- The use of connection cables from Yaskawa is recommended. You can also use Ethernet cables with the specification S/STP CAT6a or S/FTP CAT6a.
- The connection cable must not exceed the maximum length of 10m.
- The connection cable between MainDevice and SubDevice may be plugged or removed only when the modules are powered off.

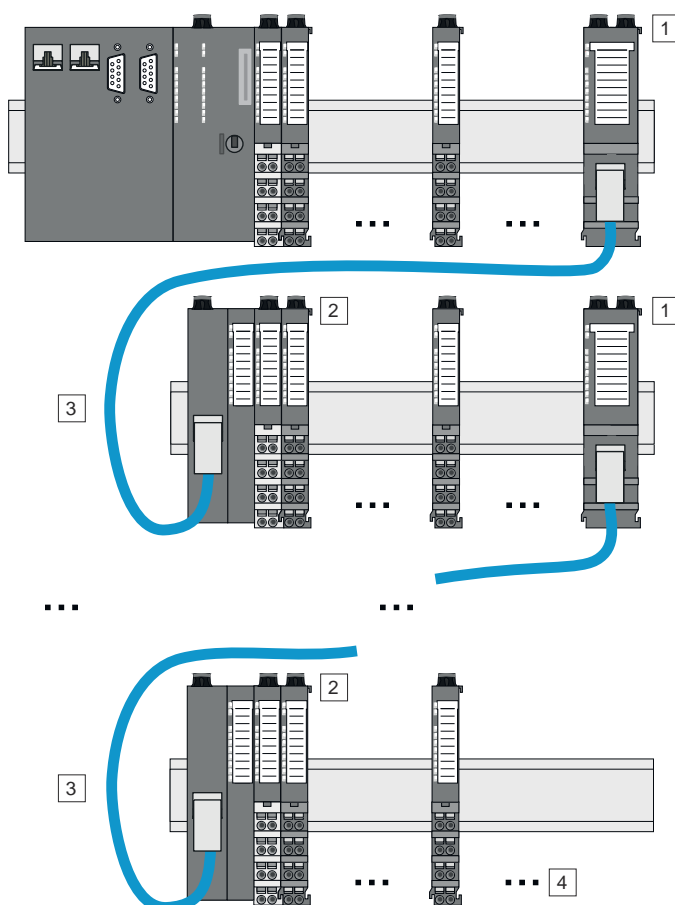








- 1 Line extension MainDevice
- 2 Line extension SubDevice
- 3 Connection cable
- 4 Depending on the line extension used, the max. number of pluggable modules on the System SLIO bus is reduced accordingly.

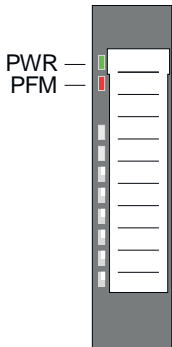Structure > Line extension SubDevice


### 3.2.2.2 LEDs












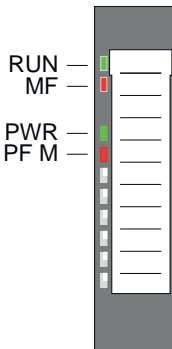






#### Line extension SubDevice 061-1BA00 - version 1




| PWR<br><br>green | PF M<br><br>red | Description   |
|---|--|---|
|                  |                 | The line extension SubDevice is power supplied.             |
|                  |                 | The power supply of the line extension SubDevice is faulty. |








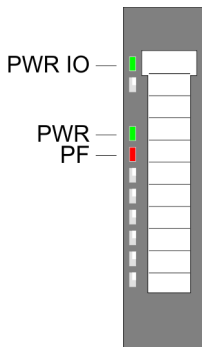

#### Line extension SubDevice 061-1BA01 - version 2



| RUN<br><br>green | MF<br><br>red | PWR<br><br>green | PF M<br><br>red | Description  |
|---|--|---|--|--|
|                  |               | X   | X  | Bus communication is OK.<br>Module status is OK.                             |
|                  |               | X   | X  | Bus communication is OK.<br>Module status reports an error.                  |
|                 |              | X   | X  | Bus communication is not possible.<br>Module status reports an error.        |
|                |             | X   | X  | Error at bus power supply.   |
| X   | <br>2Hz     | X   | X  | Error in configuration ' <a href="#">Trouble shooting - LEDs'...page 32.</a> |
| X   | X  |                |               | Power supply line extension SubDevice is OK.                                 |
|                | X  |                |               | Power supply line extension MainDevice reports an error.                     |
| not relevant: X   |  |   |  |  |

#### LEDs power module



| PWR IO<br><br>green | PWR<br><br>green | PF<br><br>red | Description                               |
|--|---|--|---|
|                     | X   |               | Power section supply OK.                  |
| X  |                  |               | Electronic section supply OK.             |
| X  |                  |               | Fuse electronic section supply defective. |
| not relevant: X  |   |  |   |

### 3.3 Mounting and wiring

**Please note!**

For the mounting of a line extension, there are certain rules that must be observed:

**CAUTION**

When 06x-1xA00 used - version 1:

- Please use connection cables from Yaskawa for connection. The use of normal Ethernet cable can cause damage!
- The connection cable must not exceed the maximum length of 2m.
- The connection cable between MainDevice and SubDevice may be plugged or removed only when the modules are powered off.

When 06x-1xA01 used - version 2:

- The use of connection cables from Yaskawa is recommended. You can also use Ethernet cables with the specification S/STP CAT6a or S/FTP CAT6a.
- The connection cable must not exceed the maximum length of 10m.
- The connection cable between MainDevice and SubDevice may be plugged or removed only when the modules are powered off.




- *By means of the line extension 1 line of modules can be divided to maximum 5 lines.*
- *For each line extension the maximum number of pluggable modules at the System SLIO bus is decreased:*
  - *with 06x-1xA00 by 1 module.*
  - *with 06x-1xA01 by 2 modules.*
- *The line extension MainDevice is to be placed at the end of the line.*
- *After the MainDevice the line has to start with a line extension SubDevice.*
- *Line extension modules are not considered in the listing of the integrated web page of the coupler or CPU respectively the allocation of the slots.*
- *The usage of additional power modules within a line is allowed.*
- *To use the line extension no special configuration is required.*

[‘Mounting line extension’...page 22](#)

[‘Wiring line extension’...page 26](#)

3.4 Deployment 06x-1xA00 - version 1

Line extension 06x-1xA00

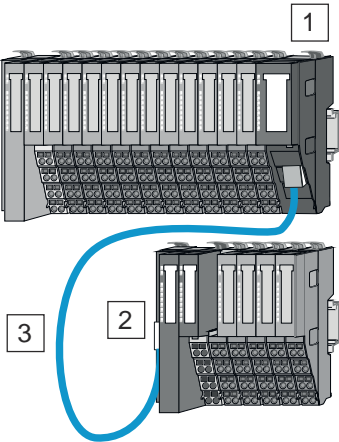

The line extension may only consist of the following components:

- Line extension MainDevice **1**: 060-1AA00
- Line extension SubDevice **2**: 061-1BA00
- Connection cable **3** from Yaskawa:
  - 950-0KD30: RJ45, length 2m




*Please note that mixing MainDevice and SubDevice between version 1 and version 2 is not permitted and will lead to malfunctions!*

The 06x-1xA00 is supported by the following System SLIO modules

| System SLIO component | Order number | from version |
|-----------------------|--------------|--------------|
| CPU 013C              | 013-CCF0R00  | HW: 01       |
| CPU 014               | 014-CEF0R00  | FW: V1.2.20  |
|                       | 014-CEF0R01  | HW: 01       |
| CPU 015               | 015-CEFPR00  | FW: V1.2.20  |
|                       | 015-CEFPR01  | HW: 01       |
|                       | 015-CEFNR00  | HW: 01       |
| CPU 017               | 017-CEFPR00  | HW: 01       |
| PROFIBUS DP coupler   | 053-1DP00    | HW: 06       |
| EtherCAT SubDevice    | 053-1EC01    | HW: 01       |
| PROFINET IO device    | 053-1PN00    | HW: 04       |
| EtherNet/IP adapter   | 053-1IP00    | FW: V2.0.12  |
| Modbus/TCP server     | 053-1MT00    | HW: 03       |


## Line extension cabling

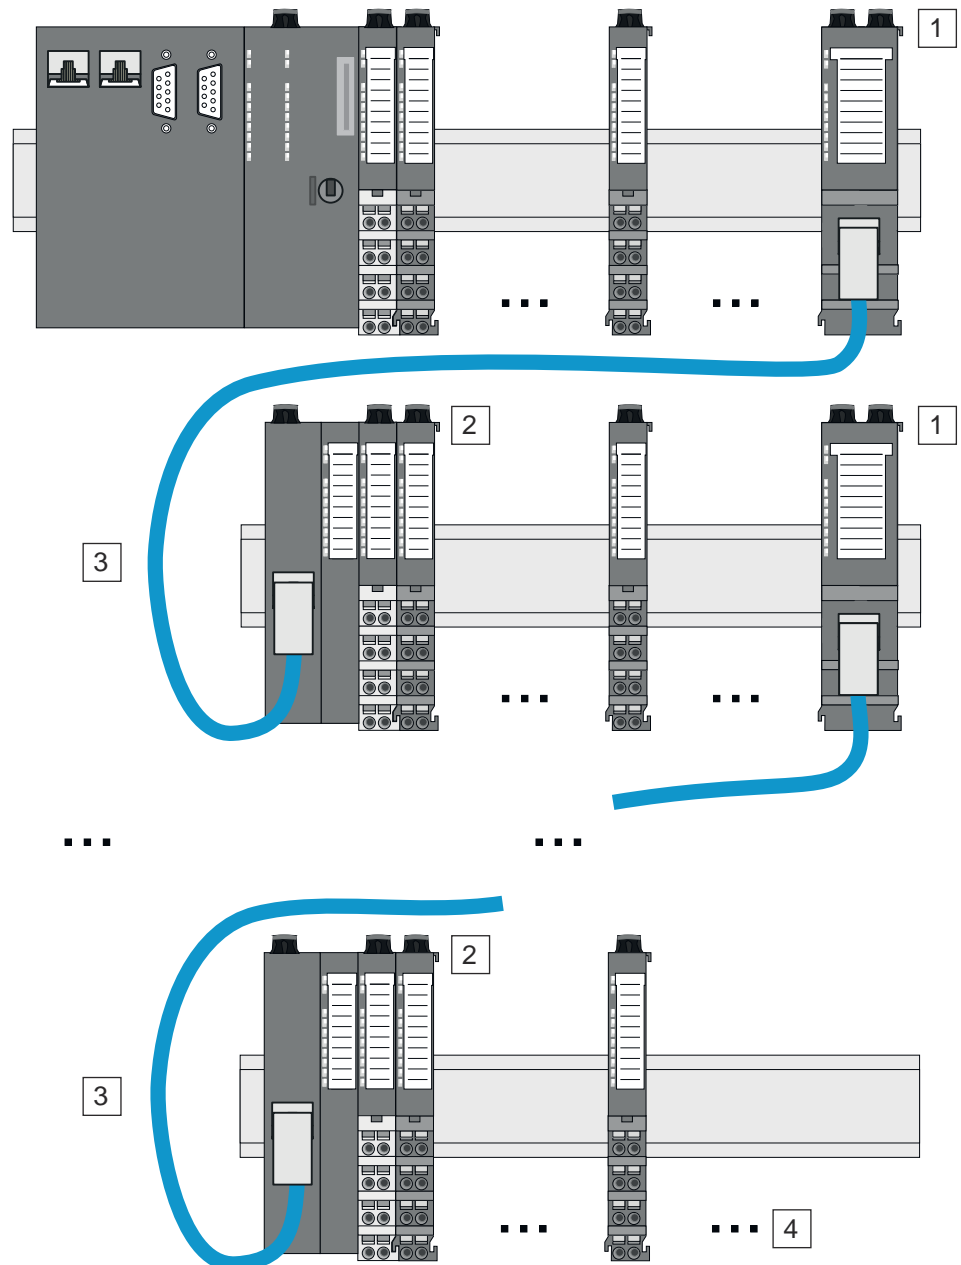

- 1 Line extension MainDevice 060-1AA00
- 2 Line extension SubDevice061-1BA00
- 3 Connection cable from Yaskawa with a maximum length of 2m.
- 4 For each line extension the max. number of pluggable modules is decreased by 1.

### 3.5 Deployment 06x-1xA01 - version 2

#### Line extension 06x-1xA01

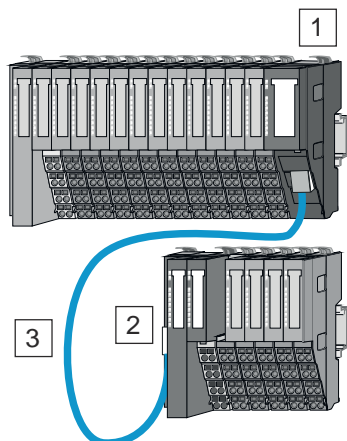

The line extension may only consist of the following components:

- Line extension MainDevice [1]: 060-1AA01
- Line extension SubDevice [2]: 061-1BA01
- Connection cable [3] from Yaskawa:
  - 950-0KD30: RJ45, length 2m
  - 950-0KD40: RJ45, length 5m
  - 950-0KD50: RJ45, length 10m



*Please note that mixing MainDevice and SubDevice between version 1 and version 2 is not permitted and will lead to malfunctions!*




*The line extension 06x-1xA01 supports isochronous mode and time synchronization functions such as synchronized time stamps in ETS and counter modules. When using synchronization functions, please note that due to delays on the backplane bus, the maximum number of modules is limited to 32 and you may only extend your system with one line extension!*

The 06x-1xA01 is supported by the following modules and components:

| System SLIO component   | Order number | from version |
|-------------------------|--------------|--------------|
| CPU 013C                | 013-CCF0R00  | HW: 01       |
| CPU 014                 | 014-CEF0R01  | HW: 02       |
| CPU 015                 | 015-CEFPR01  | HW: 02       |
|                         | 015-CEFNR00  | HW: 03       |
| CPU 017                 | 017-CEFPR00  | HW: 02       |
| CPU 019                 | 019-CEFPM00  | HW: 01       |
| EtherCAT SubDevice      | 053-1EC01    | HW: 01       |
| EtherNet/IP adapter     | 053-1IP01    | HW: 01       |
| MECHATROLINK-IV SDevice | 053-1ML40    | HW: 01       |
| Modbus/TCP server       | 053-1MT01    | HW: 01       |
| PROFIBUS DP coupler     | 053-1DP00    | HW: 06       |
| PROFINET IO device      | 053-1PN01    | HW: 01       |



## Line extension cabling

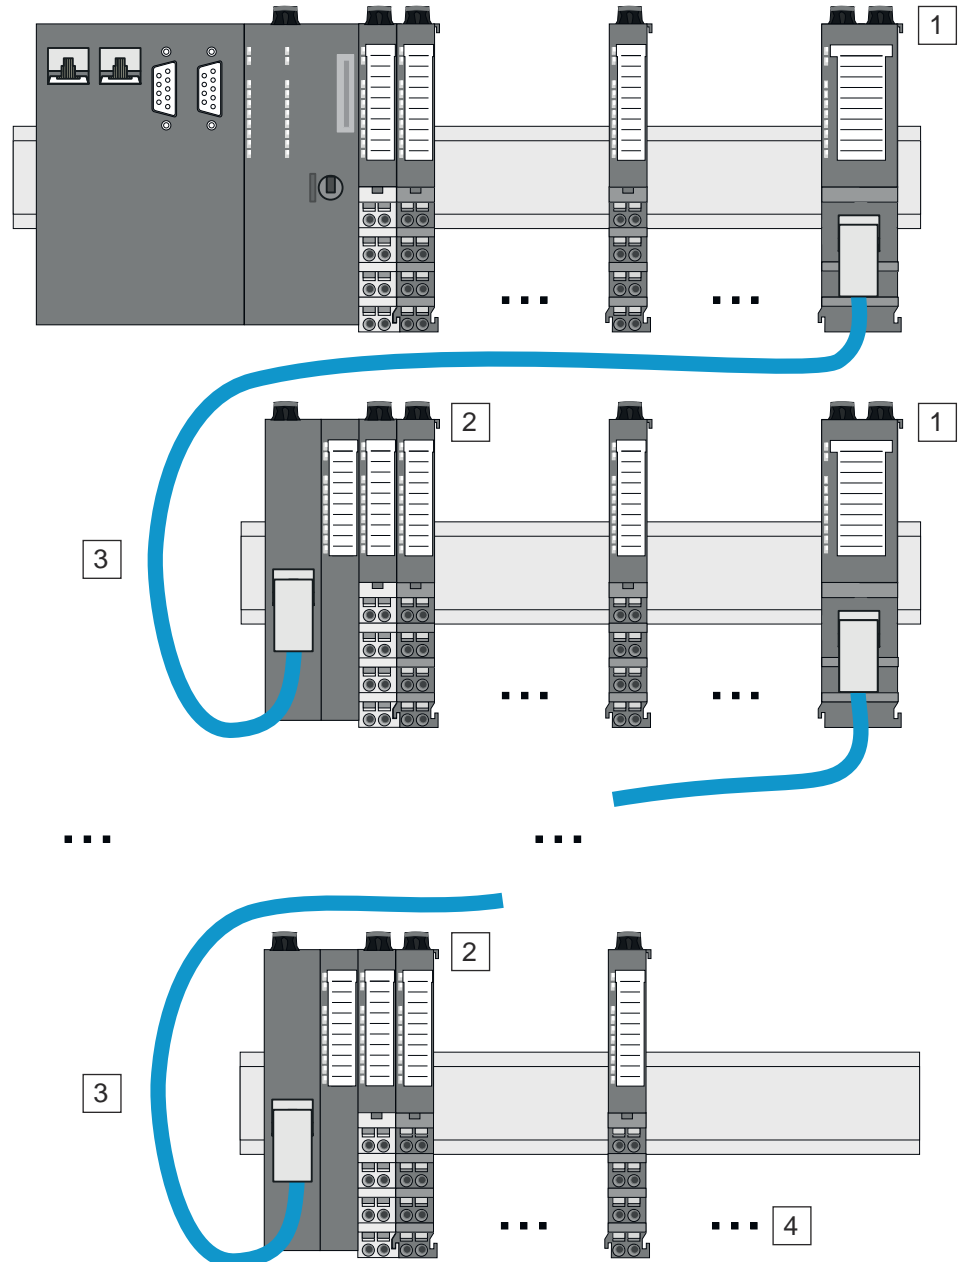

- 1 Line extension MainDevice 060-1AA01
- 2 Line extension SubDevice 061-1BA01
- 3 Connection cable from Yaskawa with a maximum length of 10m.
- 4 For each line extension the max. number of pluggable modules is decreased by 2.

## 3.6 Technical data

### 3.6.1 060-1AA00 Line extension MainDevice - version 1

| Order no.                                      | 060-1AA00                                  |
|--|--|
| Type   | IM 060 - Line extension MainDevice         |
| Module ID                                      | 8080 8080                                  |
| <b>Technical data power supply</b>             |  |
| Power supply (rated value)                     | DC 5 V                                     |
| Power supply (permitted range)                 | -  |
| Reverse polarity protection                    | -  |
| Current consumption (no-load operation)        | 50 mA                                      |
| Current consumption (rated value)              | -  |
| Inrush current                                 | -  |
| $I^2t$   | -  |
| Max. current drain at backplane bus            | -  |
| Max. current drain load supply                 | -  |
| Power loss                                     | 0.25 W                                     |
| <b>Status information, alarms, diagnostics</b> |  |
| Status display                                 | yes  |
| Interrupts                                     | no   |
| Process alarm                                  | no   |
| Diagnostic interrupt                           | no   |
| Diagnostic functions                           | no   |
| Diagnostics information read-out               | none                                       |
| Supply voltage display                         | yes  |
| Service Indicator                              | none                                       |
| Group error display                            | yes  |
| Channel error display                          | none                                       |
| <b>Hardware configuration</b>                  |  |
| Racks, max.                                    | 4  |
| Modules per rack, max.                         | total max. 64 minus number line extensions |
| Number of digital modules, max.                | -  |
| Number of analog modules, max.                 | -  |
| <b>Communication</b>                           |  |
| Fieldbus                                       | SLIO                                       |
| Type of interface                              | -  |
| Connector                                      | RJ45                                       |
| Topology                                       | -  |
| Electrically isolated                          | -  |

| Order no.                       | 060-1AA00                  |
|---------------------------------|----------------------------|
| Number of participants, max.    | -                          |
| Node addresses                  | -                          |
| Transmission speed, min.        | -                          |
| Transmission speed, max.        | -                          |
| Address range inputs, max.      | -                          |
| Address range outputs, max.     | -                          |
| Number of TxPDOs, max.          | -                          |
| Number of RxPDOs, max.          | -                          |
| <b>Housing</b>                  |                            |
| Material                        | PPE / PPE GF10             |
| Mounting                        | Profile rail 35 mm         |
| <b>Mechanical data</b>          |                            |
| Dimensions (WxHxD)              | 25.8 mm x 109 mm x 76.5 mm |
| Net weight                      | 53 g                       |
| Weight including accessories    | 53 g                       |
| Gross weight                    | 68 g                       |
| <b>Environmental conditions</b> |                            |
| Operating temperature           | 0 °C to 60 °C              |
| Storage temperature             | -25 °C to 70 °C            |
| <b>Certifications</b>           |                            |
| UL certification                | yes                        |
| KC certification                | yes                        |
| UKCA certification              | yes                        |
| ChinaRoHS certification         | yes                        |

## 3.6.2 060-1AA01 Line extension MainDevice - version 2

| Order no.                                      | 060-1AA01                                     |
|--|---|
| Type   | IM 060 - Line extension MainDevice            |
| Module ID                                      | 8081 8080                                     |
| <b>Technical data power supply</b>             |   |
| Power supply (rated value)                     | DC 5 V  |
| Power supply (permitted range)                 | -   |
| Reverse polarity protection                    | -   |
| Current consumption (no-load operation)        | -   |
| Current consumption (rated value)              | 40 mA   |
| Inrush current                                 | -   |
| $I^2t$   | -   |
| Max. current drain at backplane bus            | -   |
| Max. current drain load supply                 | -   |
| Power loss                                     | 0.2 W   |
| <b>Status information, alarms, diagnostics</b> |   |
| Status display                                 | yes   |
| Interrupts                                     | no  |
| Process alarm                                  | no  |
| Diagnostic interrupt                           | no  |
| Diagnostic functions                           | no  |
| Diagnostics information read-out               | none  |
| Supply voltage display                         | yes   |
| Service Indicator                              | none  |
| Group error display                            | yes   |
| Channel error display                          | none  |
| <b>Hardware configuration</b>                  |   |
| Racks, max.                                    | 5   |
| Modules per rack, max.                         | total max. 64 minus 2x number line extensions |
| Number of digital modules, max.                | -   |
| Number of analog modules, max.                 | -   |
| <b>Communication</b>                           |   |
| Fieldbus                                       | SLIO  |
| Type of interface                              | -   |
| Connector                                      | RJ45  |
| Topology                                       | -   |
| Electrically isolated                          | -   |
| Number of participants, max.                   | -   |
| Node addresses                                 | -   |

| Order no.                       | 060-1AA01                  |
|---------------------------------|----------------------------|
| Transmission speed, min.        | -                          |
| Transmission speed, max.        | -                          |
| Address range inputs, max.      | -                          |
| Address range outputs, max.     | -                          |
| Number of TxPDOs, max.          | -                          |
| Number of RxPDOs, max.          | -                          |
| <b>Housing</b>                  |                            |
| Material                        | PPE / PPE GF10             |
| Mounting                        | Profile rail 35 mm         |
| <b>Mechanical data</b>          |                            |
| Dimensions (WxHxD)              | 25.8 mm x 109 mm x 76.5 mm |
| Net weight                      | 53 g                       |
| Weight including accessories    | 53 g                       |
| Gross weight                    | 68 g                       |
| <b>Environmental conditions</b> |                            |
| Operating temperature           | 0 °C to 60 °C              |
| Storage temperature             | -40 °C to 70 °C            |
| <b>Certifications</b>           |                            |
| UL certification                | yes                        |
| KC certification                | yes                        |
| UKCA certification              | yes                        |
| ChinaRoHS certification         | yes                        |

## 3.6.3 061-1BA00 Line extension SubDevice - version 1

| Order no.                                      | 061-1BA00                                  |
|--|--|
| Type   | IM 061 - Line extension SubDevice          |
| Module ID                                      | -  |
| <b>Technical data power supply</b>             |  |
| Power supply (rated value)                     | DC 24 V                                    |
| Power supply (permitted range)                 | DC 20.4...28.8 V                           |
| Reverse polarity protection                    | ✓  |
| Current consumption (no-load operation)        | 10 mA                                      |
| Current consumption (rated value)              | 0.95 A                                     |
| Inrush current                                 | 3.9 A                                      |
| I <sup>2</sup> t                               | 0.14 A <sup>2</sup> s                      |
| Max. current drain at backplane bus            | 2 A  |
| Max. current drain load supply                 | 10 A                                       |
| Power loss                                     | 1.4 W                                      |
| <b>Status information, alarms, diagnostics</b> |  |
| Status display                                 | yes  |
| Interrupts                                     | no   |
| Process alarm                                  | no   |
| Diagnostic interrupt                           | no   |
| Diagnostic functions                           | no   |
| Diagnostics information read-out               | none                                       |
| Supply voltage display                         | yes  |
| Service Indicator                              | none                                       |
| Group error display                            | yes  |
| Channel error display                          | none                                       |
| <b>Hardware configuration</b>                  |  |
| Racks, max.                                    | 4  |
| Modules per rack, max.                         | total max. 64 minus number line extensions |
| Number of digital modules, max.                | -  |
| Number of analog modules, max.                 | -  |
| <b>Communication</b>                           |  |
| Fieldbus                                       | SLIO                                       |
| Type of interface                              | -  |
| Connector                                      | RJ45                                       |
| Topology                                       | -  |
| Electrically isolated                          | -  |
| Number of participants, max.                   | -  |
| Node addresses                                 | -  |

| Order no.                       | 061-1BA00                  |
|---------------------------------|----------------------------|
| Transmission speed, min.        | -                          |
| Transmission speed, max.        | -                          |
| Address range inputs, max.      | -                          |
| Address range outputs, max.     | -                          |
| Number of TxPDOs, max.          | -                          |
| Number of RxPDOs, max.          | -                          |
| <b>Housing</b>                  |                            |
| Material                        | PPE / PPE GF10             |
| Mounting                        | Profile rail 35 mm         |
| <b>Mechanical data</b>          |                            |
| Dimensions (WxHxD)              | 48.5 mm x 109 mm x 76.5 mm |
| Net weight                      | 155 g                      |
| Weight including accessories    | 155 g                      |
| Gross weight                    | 172.5 g                    |
| <b>Environmental conditions</b> |                            |
| Operating temperature           | 0 °C to 60 °C              |
| Storage temperature             | -25 °C to 70 °C            |
| <b>Certifications</b>           |                            |
| UL certification                | yes                        |
| KC certification                | yes                        |
| UKCA certification              | yes                        |
| ChinaRoHS certification         | yes                        |

## 3.6.4 061-1BA01 Line extension SubDevice - version 2

| Order no.                                      | 061-1BA01                                     |
|--|---|
| Type   | IM 061 - Line extension SubDevice             |
| Module ID                                      | 8082 8080                                     |
| <b>Technical data power supply</b>             |   |
| Power supply (rated value)                     | DC 24 V                                       |
| Power supply (permitted range)                 | DC 20.4...28.8 V                              |
| Reverse polarity protection                    | ✓   |
| Current consumption (no-load operation)        | 40 mA   |
| Current consumption (rated value)              | 0.75 A  |
| Inrush current                                 | 4.2 A   |
| I <sup>2</sup> t                               | 0.12 A <sup>2</sup> s                         |
| Max. current drain at backplane bus            | 3 A   |
| Max. current drain load supply                 | 10 A  |
| Power loss                                     | 2.8 W   |
| <b>Status information, alarms, diagnostics</b> |   |
| Status display                                 | yes   |
| Interrupts                                     | no  |
| Process alarm                                  | no  |
| Diagnostic interrupt                           | no  |
| Diagnostic functions                           | no  |
| Diagnostics information read-out               | none  |
| Supply voltage display                         | yes   |
| Service Indicator                              | none  |
| Group error display                            | yes   |
| Channel error display                          | none  |
| <b>Hardware configuration</b>                  |   |
| Racks, max.                                    | 5   |
| Modules per rack, max.                         | total max. 64 minus 2x number line extensions |
| Number of digital modules, max.                | -   |
| Number of analog modules, max.                 | -   |
| <b>Communication</b>                           |   |
| Fieldbus                                       | SLIO  |
| Type of interface                              | -   |
| Connector                                      | RJ45  |
| Topology                                       | -   |
| Electrically isolated                          | -   |
| Number of participants, max.                   | -   |
| Node addresses                                 | -   |



| Order no.                       | 061-1BA01                  |
|---------------------------------|----------------------------|
| Transmission speed, min.        | -                          |
| Transmission speed, max.        | -                          |
| Address range inputs, max.      | -                          |
| Address range outputs, max.     | -                          |
| Number of TxPDOs, max.          | -                          |
| Number of RxPDOs, max.          | -                          |
| <b>Housing</b>                  |                            |
| Material                        | PPE / PPE GF10             |
| Mounting                        | Profile rail 35 mm         |
| <b>Mechanical data</b>          |                            |
| Dimensions (WxHxD)              | 48.5 mm x 109 mm x 76.5 mm |
| Net weight                      | 155 g                      |
| Weight including accessories    | 155 g                      |
| Gross weight                    | 170 g                      |
| <b>Environmental conditions</b> |                            |
| Operating temperature           | 0 °C to 60 °C              |
| Storage temperature             | -40 °C to 70 °C            |
| <b>Certifications</b>           |                            |
| UL certification                | yes                        |
| KC certification                | yes                        |
| UKCA certification              | yes                        |
| ChinaRoHS certification         | yes                        |